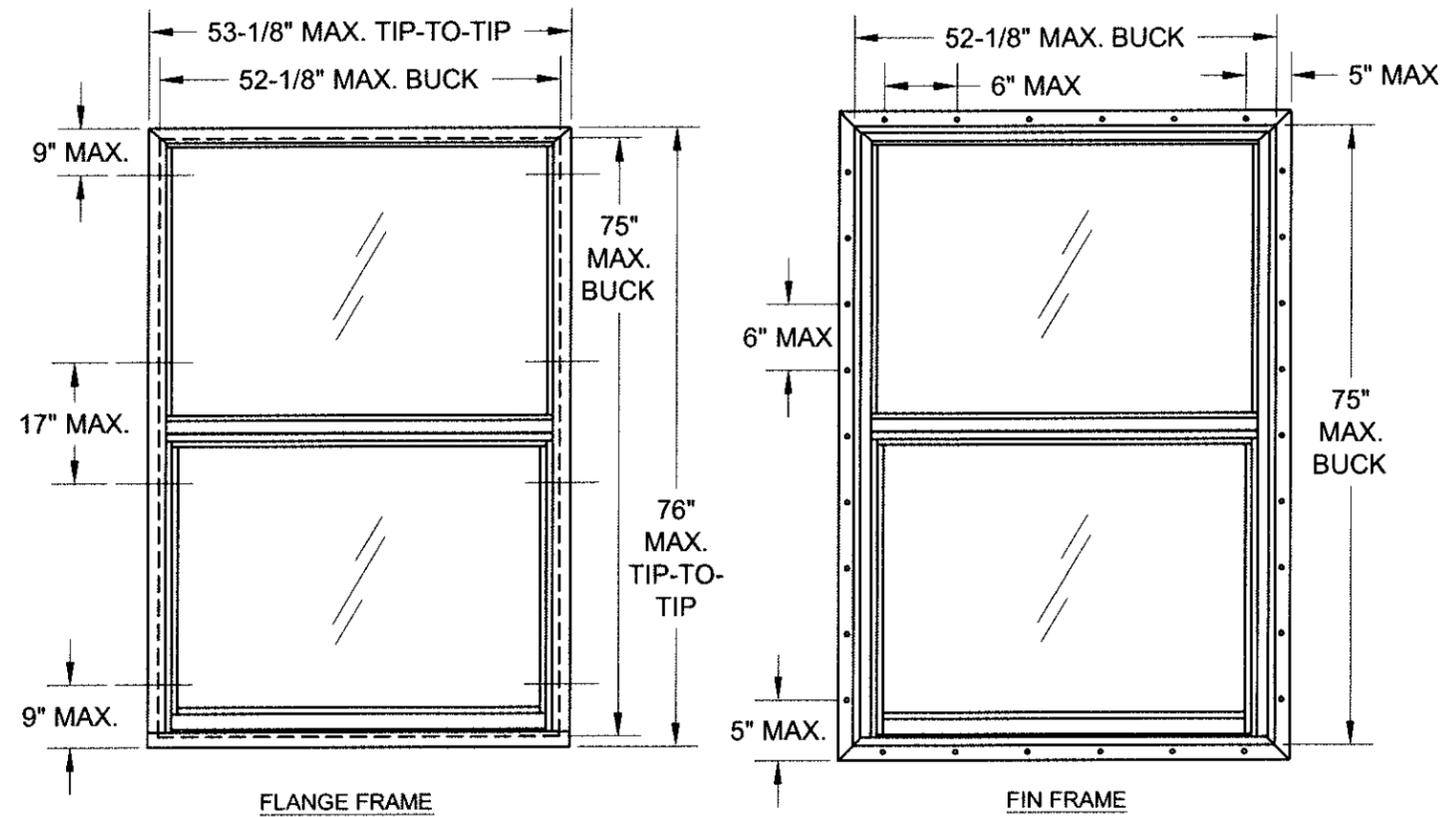


**GENERAL NOTES :**

- 1) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE FOR THE DESIGN PRESSURES LISTED.
- 2) WOOD BUCKS DEPICTED AS 1X ARE LESS THAN 1-1/2" THICK. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SOLID CONCRETE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. ATTACHMENT METHOD OF WOOD BUCKS SHALL BE DONE BY OTHERS.
- 3) SEE TABLE FOR MINIMUM EDGE DISTANCE FROM CENTER OF ANCHOR TO SUBSTRATE EDGE (EXCLUDING FINISH OR STUCCO).
- 4) SHIM EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE, USING SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS.
- 5) ANCHORS SHALL BE COATED OR CORROSION RESISTANT AS APPROPRIATE FOR SUBSTRATE MATERIAL. DISSIMILAR MATERIALS SHALL BE PROTECTED AS REQUIRED TO PREVENT REACTIONS. ALUMINUM SHALL BE PROTECTED FROM DISSIMILAR MATERIALS AS SPECIFIED IN THE FLORIDA BUILDING CODE.
- 6) ADHESIVE SEALANT SHALL BE USED BETWEEN SUBSTRATE AND FLANGE OR FIN. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS.
- 7) MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, 2.7 KSI CONCRETE AND CONCRETE MASONRY UNITS COMPLYING WITH ASTM C-90. GLAZING COMPLIES WITH ASTM E1300.
- 8) THE 1/3 STRESS INCREASE WAS NOT USED IN THIS ANCHOR EVALUATION. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF WOOD SCREWS.
- 9) EQUAL LITE SHOWN. ANCHOR QUANTITY AND SPACING APPLIES TO ORIEL SASH UNITS AS WELL. PRODUCT MAY BE INSTALLED INTO STEEL OR ALUMINUM SIMILAR TO THE WOOD INSTALLATION DETAILS.
- 10) PASS-THRU PRODUCT HAS NOT BEEN CERTIFIED FOR WATER INFILTRATION AND MUST BE LOCATED IN UNEXPOSED AREAS.
- 11) THE 200 SERIES WAS FORMERLY KNOWN AS THE 4000/4001 SERIES.

**ANCHOR LOCATIONS & SPACING**



**TABLE 3: FIN & FLANGE STANDARD WINDOWS**

Buck Size		Sash Style	Design Pressure		Certification Numbers
Width	Height		(+) psf	(-) psf	
52-1/8"	75"	Equal Lite	55	55	190-478, 479,
		Oriel	55	55	493, 494

**TABLE 4: FLANGE PASS-THRU WINDOW**

Buck Size		Design Pressure		Certification Numbers
Width	Height	(+) psf	(-) psf	
52-1/8"	51-1/2"	65	65	190-1002

**TABLE 1: FLANGE WINDOWS (STANDARD AND PASS-THRU)**

Anchor Type	Substrate	Min. Edge Dist.	Min. Embedment
#10 Steel SMS	Wood (Southern Pine)	7/16"	1-3/8"
	Steel Stud Gr 33	3/8"	.045 (18 GA)
	Aluminum-6063-T5	3/8"	1/8"
1/4" Masonry Anchor	Steel, A36	3/8"	1/8"
	Concrete	1"	1-3/8"
	Hollow CMU	2-1/2"	1-1/4"

NOTE: FOR ALL METAL SUBSTRATES, SCREW EMBEDMENT SHALL BE MIN. 3 THREADS BEYOND INSIDE FACE OF MATERIAL.

**TABLE 2: FIN WINDOWS (STANDARD WINDOW)**









Anchor Type	Substrate	Min. Edge Dist.	Min. Embedment
1-1/2" x .135" Roofing Nail	Wood (Southern Pine)	3/8"	1-7/16"
#12 Panhead SMS	Wood (Southern Pine)	9/16"	1-3/8"
#10 Trusshead Screw	Wood (Southern Pine)	7/16"	1-3/8"



**PGT**  
 1070 TECHNOLOGY DRIVE  
 NOKOMIS, FL 34275  
 FL CERT. OF AUTH. : 29296  
 A. Lynn Miller, P.E.  
 P.E. #58705

Drawn By: J. ROSOWSKI	Date: 08/08/11	Material: ALUMINUM 6063-T6	THE INFORMATION, DESIGN OR DATA CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF PGT INDUSTRIES AND CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO PORTION OF THIS DOCUMENT MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT THE EXPRESSED WRITTEN PERMISSION OF PGT INDUSTRIES.
Revised By:	Date:	Revisions:	
Description:  			Title: <b>SINGLE HUNG INST., STD. MEETING RAIL</b>
Series/Model: SH-200 & 200PT	Scale: NTS	Sheet: 1 of 3	
Rev:			

INSTALLATION WITH FLANGE FRAME

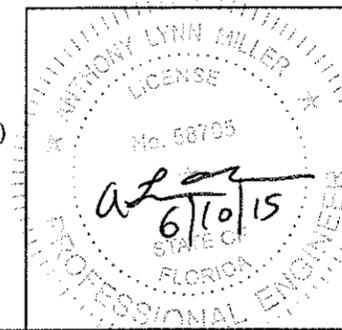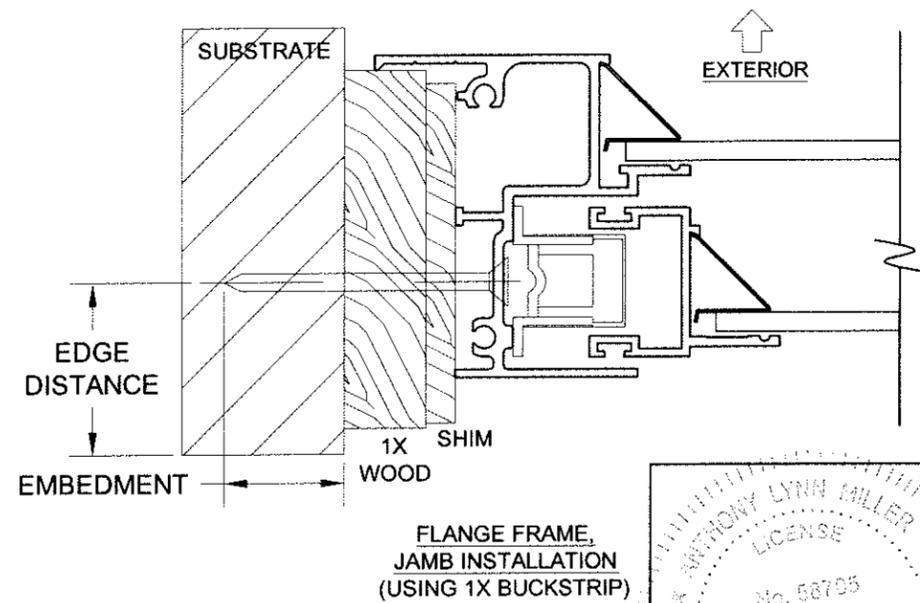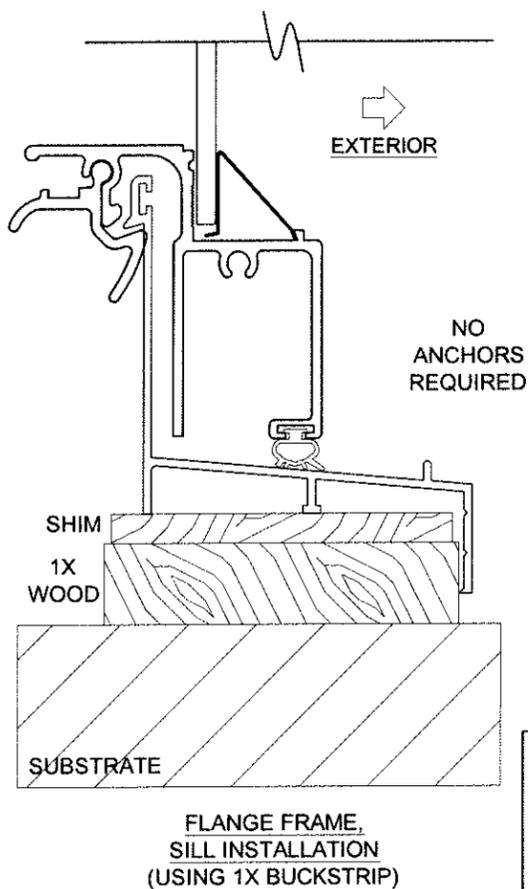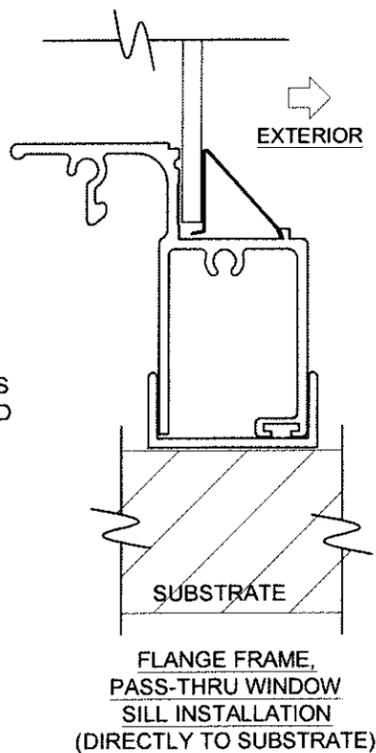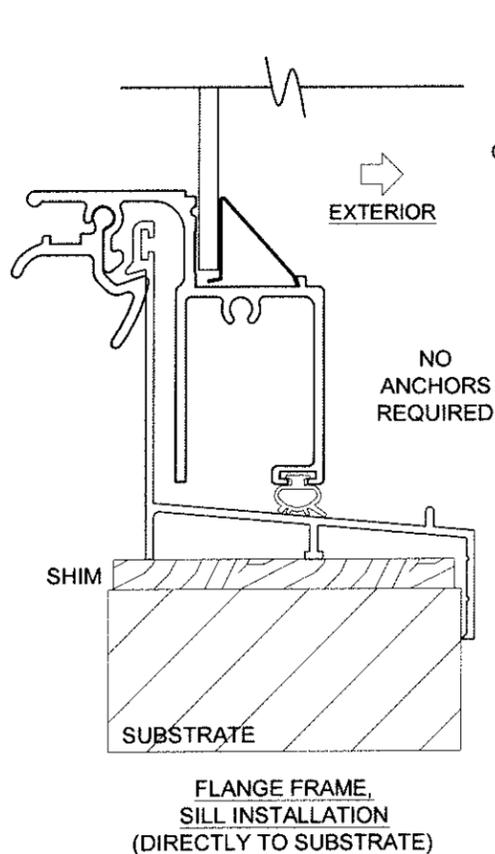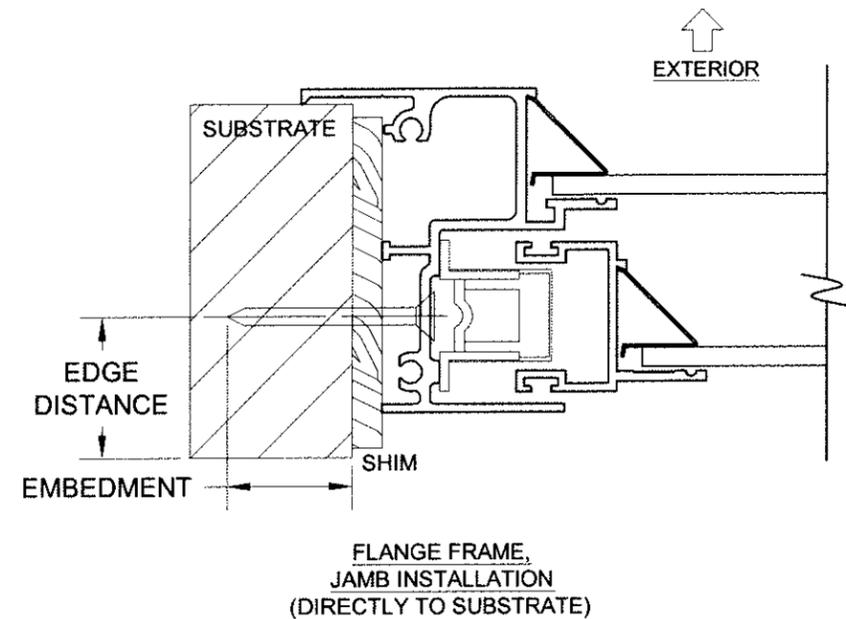
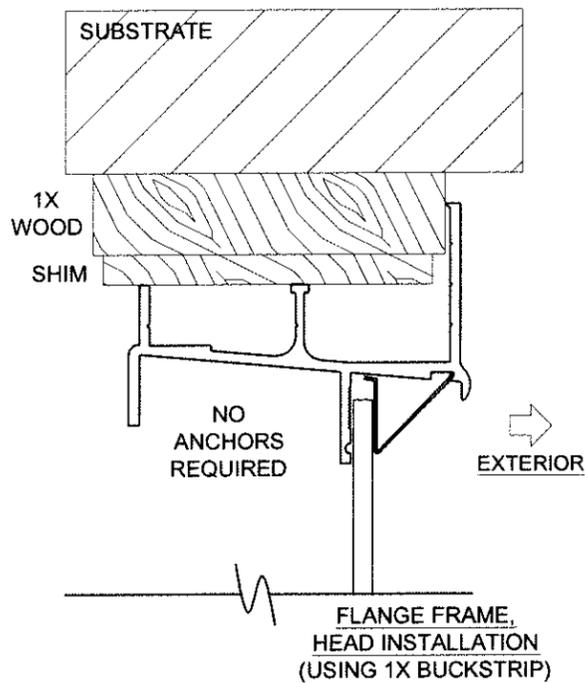
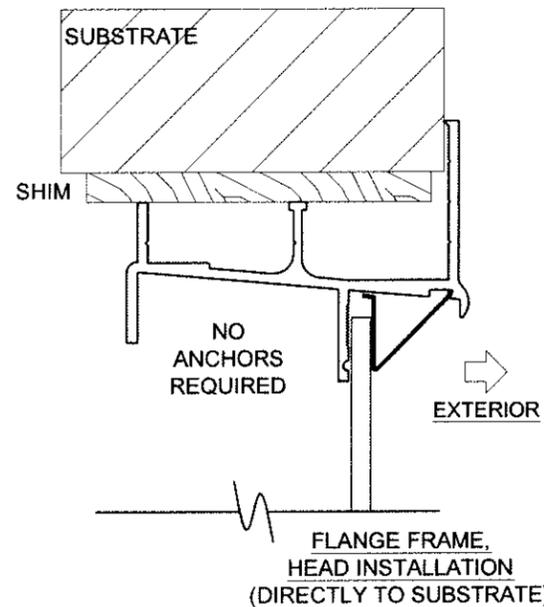


INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR ANCHORAGE, SUBSTRATE AND SPACING REQUIREMENTS.
- 2) GLASS SHOWN AS EXAMPLE. MAY VARY BY SERIES AND DESIGN PRESSURE REQUIREMENTS.
- 3) FOR SMOOTH SASH OPERATION, THE ANCHORS MUST BE FLATHEADS.
- 4) MAX. SHIM THICKNESS TO BE 1/4".
- 5) FLANGE MAY BE REMOVED TO CREATE EQUAL-LEG FRAME - USE FLANGE FRAME INSTALLATION.

<p>1070 TECHNOLOGY DRIVE NOKOMIS, FL 34275 FL CERT. OF AUTH. : 29296</p>	Drawn By: J. ROSOWSKI	Date: 08/08/11	Material: ALUMINUM 6063-T6	THE INFORMATION, DESIGN OR DATA CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF PGT INDUSTRIES AND CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO PORTION OF THIS DOCUMENT MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT THE EXPRESSED WRITTEN PERMISSION OF PGT INDUSTRIES.
	Revised By:	Date:	Revisions:	
Description: Title: <b>SINGLE HUNG INST., STD. MEETING RAIL</b>				Rev:
A. Lynn Miller, P.E. P.E. #58705	Series/Model: SH-200 & 200PT	Scale: NTS	Sheet: 2 of 3	

INSTALLATION WITH FIN FRAME

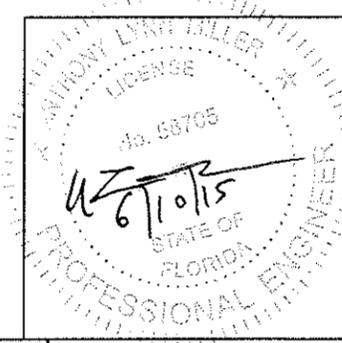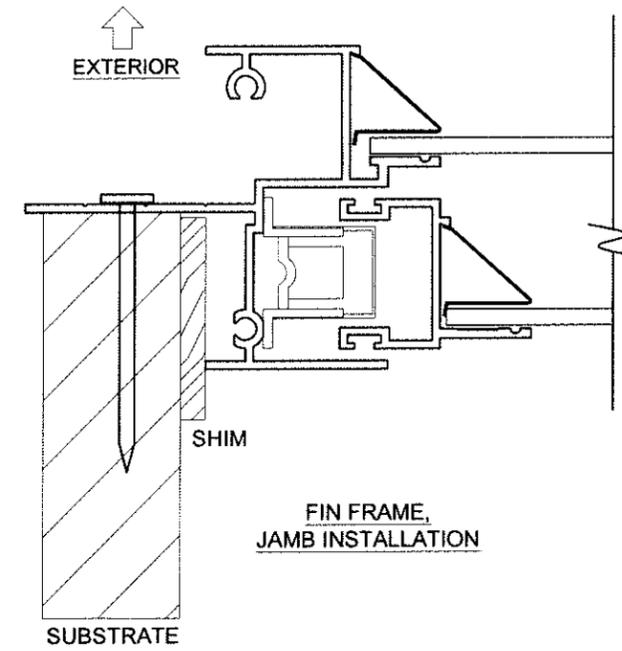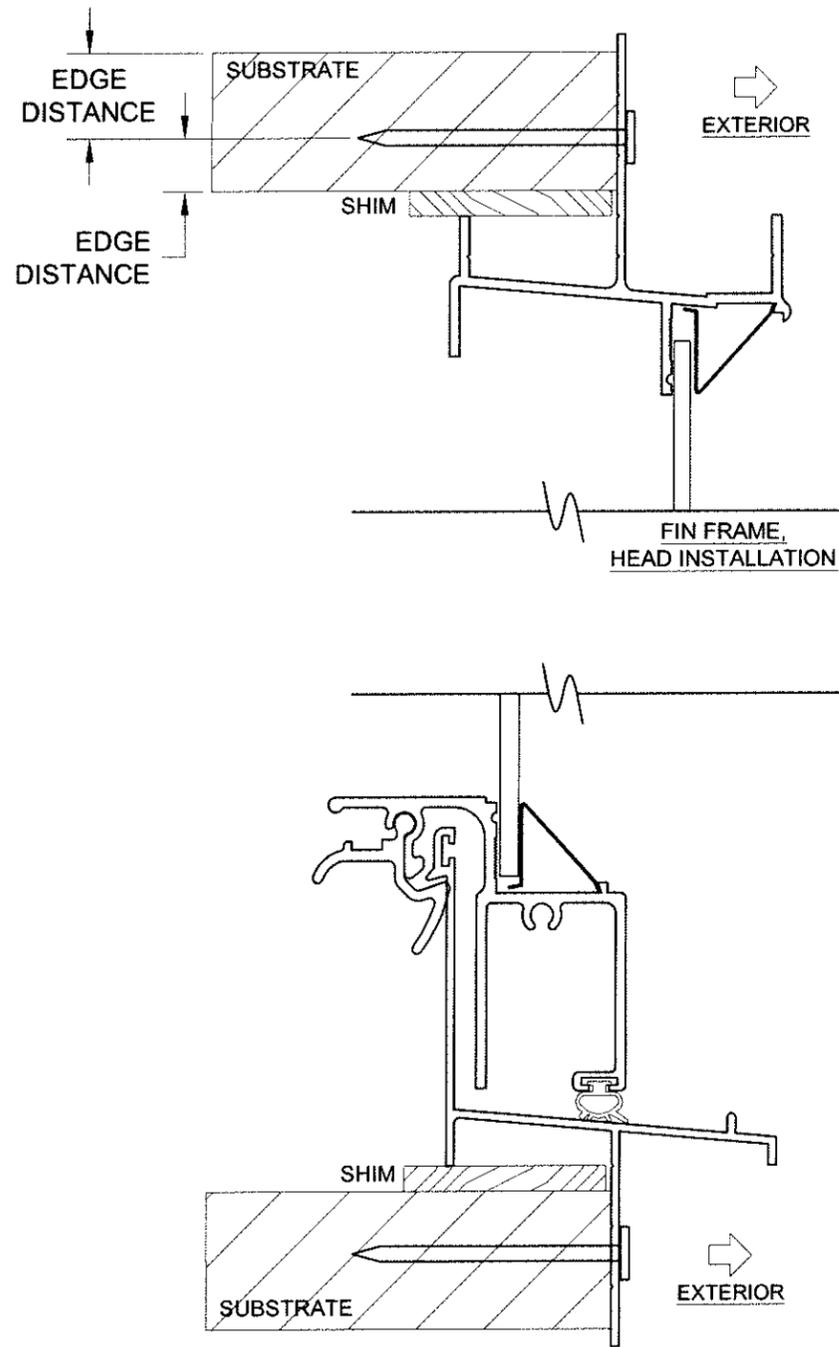

INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR ANCHORAGE, SUBSTRATE AND SPACING REQUIREMENTS.
- 2) GLASS SHOWN AS EXAMPLE. MAY VARY BY SERIES AND DESIGN PRESSURE REQUIREMENTS.
- 3) FOR SMOOTH SASH OPERATION, THE ANCHORS MUST BE FLATHEADS.
- 4) MAX. SHIM THICKNESS TO BE 1/4".
- 5) FIN MAY BE REMOVED TO CREATE EQUAL-LEG FRAME - USE FLANGE FRAME INSTALLATION.

 1070 TECHNOLOGY DRIVE NOKOMIS, FL 34275 FL CERT. OF AUTH. : 29296	Drawn By:	Date:	Material:	THE INFORMATION, DESIGN OR DATA CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF PGT INDUSTRIES AND CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO PORTION OF THIS DOCUMENT MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT THE EXPRESSED WRITTEN PERMISSION OF PGT INDUSTRIES.
	J. ROSOWSKI	08/08/11	ALUMINUM 6063-T6	
	Revised By:	Date:	Revisions:	
	Description:			
	Title:			
	<b>SINGLE HUNG INST., STD. MEETING RAIL</b>			
A. Lynn Miller, P.E. P.E. #58705	Series/Model:	Scale:	Sheet:	Drawing No.
	SH-200 & 200PT	NTS	3 of 3	1032411JR
				Rev: