

GENERAL NOTES :

- 1) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE FOR THE DESIGN PRESSURES LISTED.
- 2) WOOD BUCKS DEPICTED AS 1X ARE LESS THAN 1-1/2" THICK. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SOLID CONCRETE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. ATTACHMENT METHOD OF WOOD BUCKS SHALL BE DONE BY OTHERS.
- 3) SEE TABLE FOR MINIMUM EDGE DISTANCE FROM CENTER OF ANCHOR TO SUBSTRATE EDGE (EXCLUDING FINISH OR STUCCO).
- 4) SHIM EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE, USING SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS.
- 5) ANCHORS SHALL BE COATED OR CORROSION RESISTANT AS APPROPRIATE FOR SUBSTRATE MATERIAL. DISSIMILAR MATERIALS SHALL BE PROTECTED AS REQUIRED TO PREVENT REACTIONS. ALUMINUM SHALL BE PROTECTED FROM DISSIMILAR MATERIALS AS SPECIFIED IN THE FLORIDA BUILDING CODE.
- 6) ADHESIVE SEALANT SHALL BE USED BETWEEN SUBSTRATE AND FLANGE OR FIN. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS.
- 7) MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, 2.7 KSI CONCRETE AND CONCRETE MASONRY UNITS COMPLYING WITH ASTM C-90. GLAZING COMPLIES WITH ASTM E1300.
- 8) THE 1/3 STRESS INCREASE WAS NOT USED IN THIS ANCHOR EVALUATION. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF WOOD SCREWS.
- 9) IF THE EXACT PRODUCT SIZE IS NOT LISTED IN THE TABLES, ALWAYS ROUND UP TO THE NEXT LARGER VALUE.

TABLE 1:



Anchor Type	Substrate	Min. Edge Dist.	Min. Embedment
#12 Steel SMS	Wood (Southern Pine)	9/16"	1-3/8"
	Steel Stud Gr 33	3/8"	.045 (18 GA)
	Aluminum-6063-T5	3/8"	1/8"
	Steel, A36	3/8"	1/8"
1/4" Masonry Anchor	Concrete	1"	1-3/8"
	Hollow CMU	2-1/2"	1-1/4"

NOTE: FOR ALL METAL SUBSTRATES, SCREW EMBEDMENT SHALL BE MIN. 3 THREADS BEYOND INSIDE FACE OF MATERIAL.

TABLE 2:





As-Tested Configurations							
Max. Nom. Size (in)	Configuration	Swing Direction	Frame Type	Sill Type	DP (PSF)	Certification Number	Glass
36x80	Single (X)	Out-swing	Z-bar/Box	High (bumper)	+/- 50	190-789, 791	Min. 1/8" Temp., Mono. or I.G.
36x96	Single (X)	Out-swing	Z-bar/Box	Medium (bumper)	+/- 35	190-792	
72x96	Double (XX)	Out-swing	Z-bar/Box	Medium (bumper)	+/- 35		
36x96	Single (X)	Out/In-swing	Z-bar/Box	Low (saddle)	+/- 35*	793, 794	
72x96	Double (XX)	Out/In-swing	Z-bar/Box	Low (saddle)	+/- 35*		
*Limited Water (Water Infiltration Tested at 0 psf).							

ANCHOR LOCATIONS & SPACING

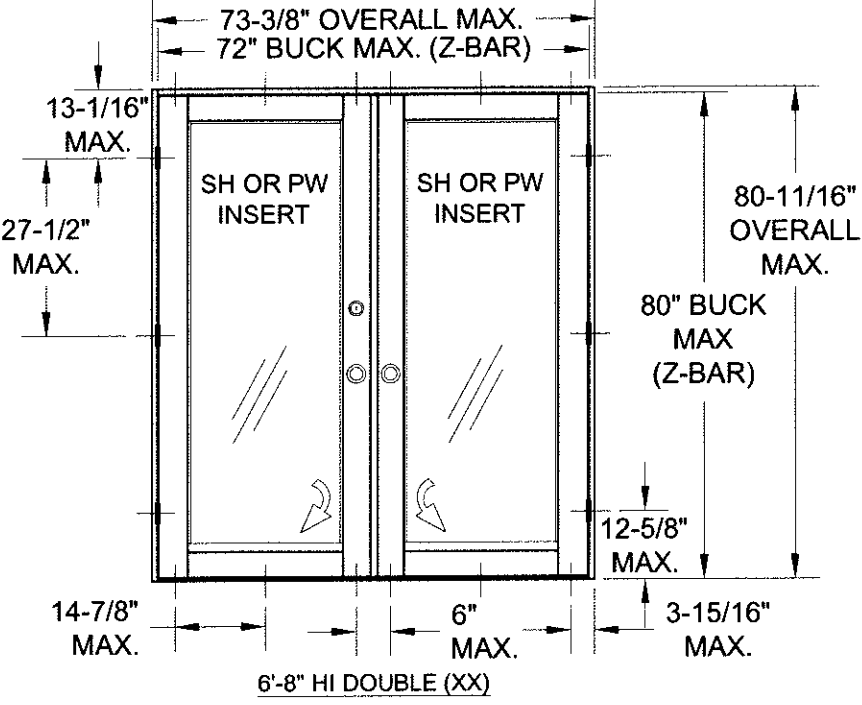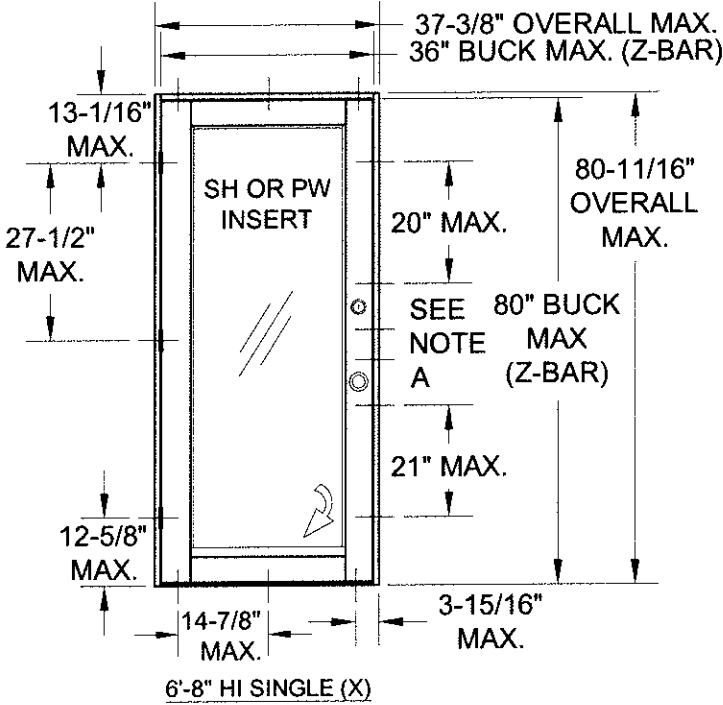



NOTE A:

ANCHORS ARE REQUIRED WITHIN 3" OF THE CENTERLINE OF THE HANDLE AND/OR DEADBOLT.

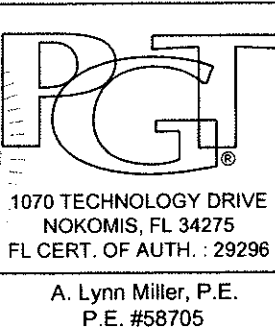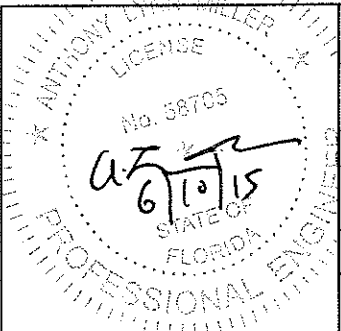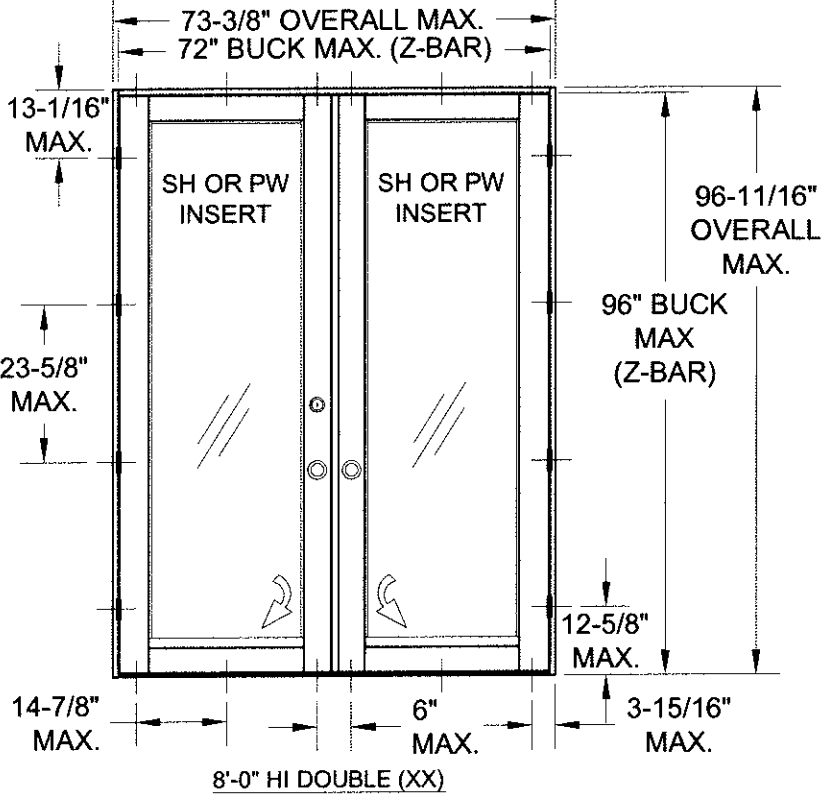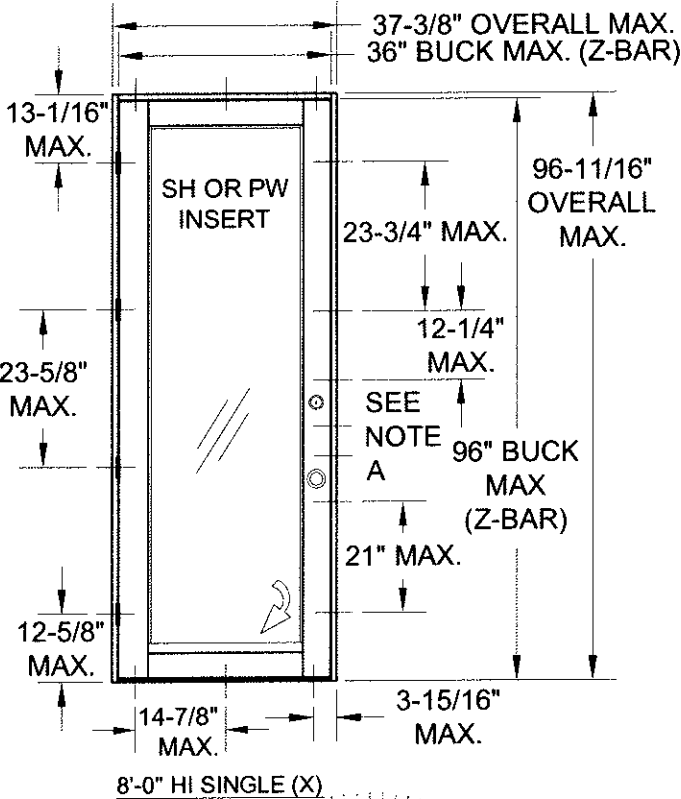








Drawn By: J. ROSOWSKI		Date: 09/30/11	Material: ALUMINUM 6063-T6	THE INFORMATION, DESIGN OR DATA CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF PGT INDUSTRIES AND CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO PORTION OF THIS DOCUMENT MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT THE EXPRESSED WRITTEN PERMISSION OF PGT INDUSTRIES.
Revised By:	Date:	Revisions:		
Description:				
Title: CABANA DOOR INSTALLATION				
Series/Model: CD-290	Scale: NTS	Sheet: 1 of 3	Drawing No. 1093011JR	Rev:

INSTALLATION WITH BOX FRAME

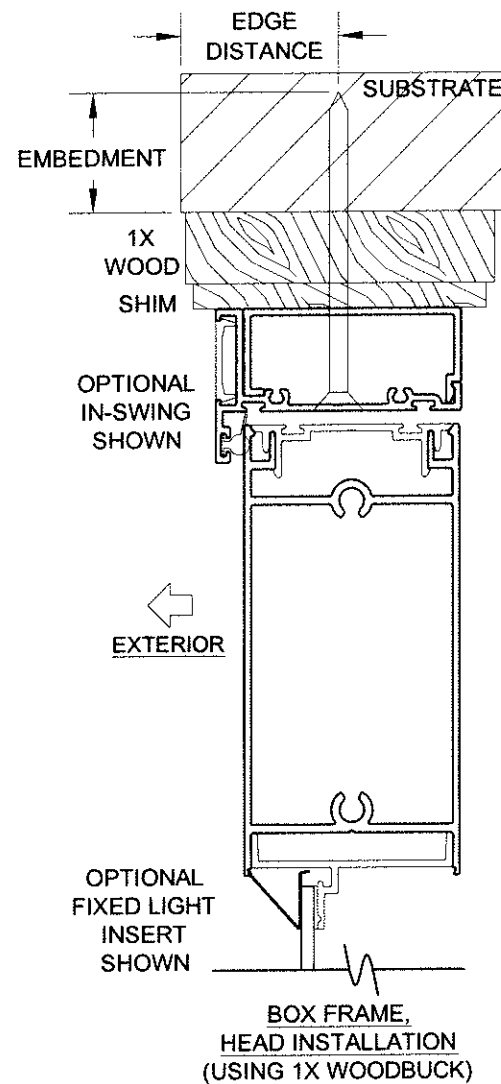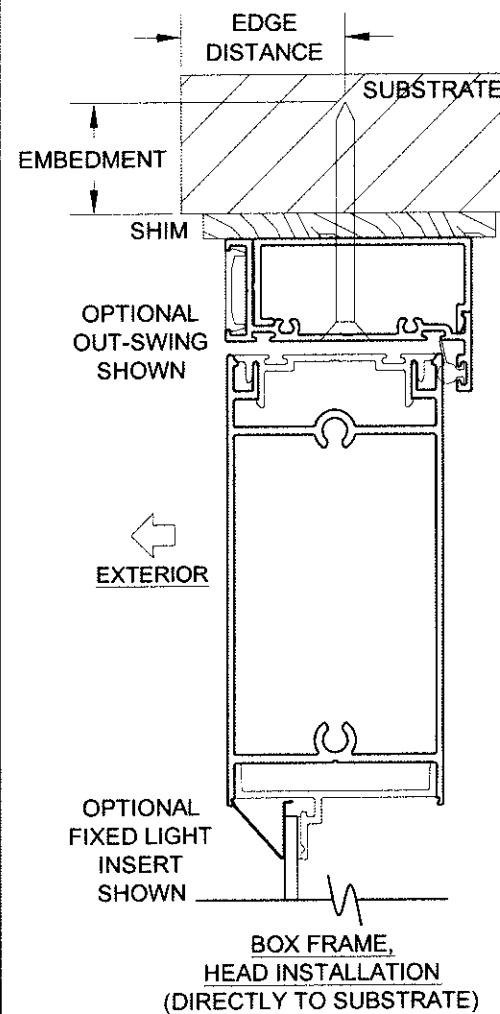

INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR SPACING REQUIREMENTS.
- 2) SEE TABLE 1 FOR ANCHORAGE AND SUBSTRATE REQUIREMENTS.
- 3) MAX. SHIM THICKNESS TO BE 1/4".
- 4) FOR HARDWARE DETAILS, SEE SHEET 3.

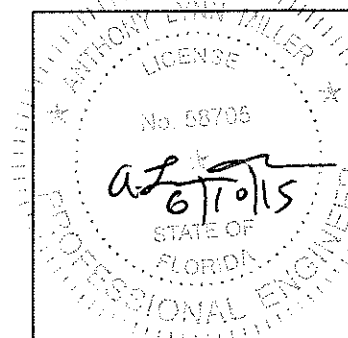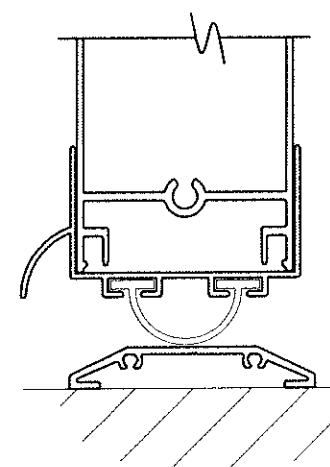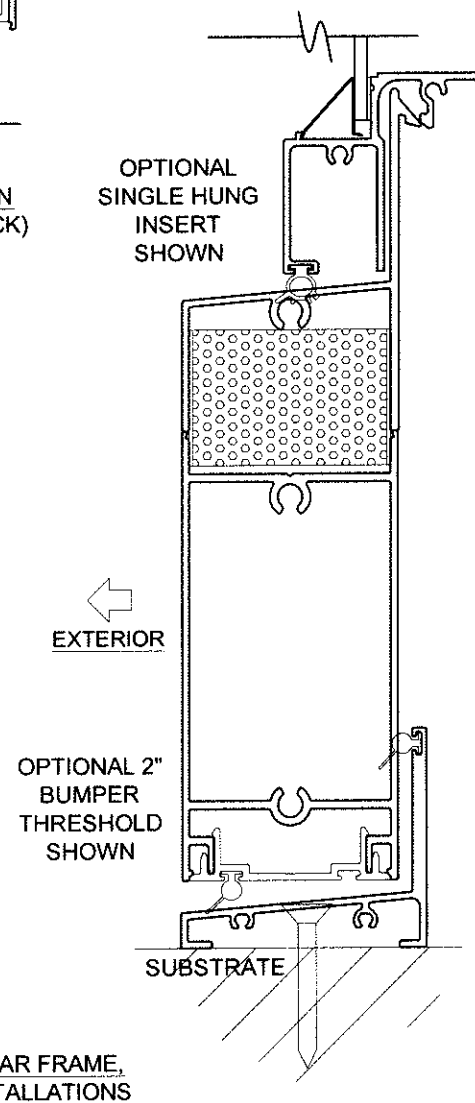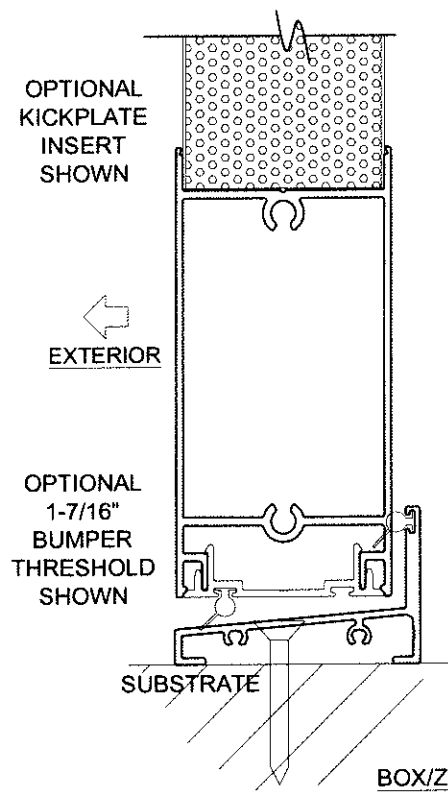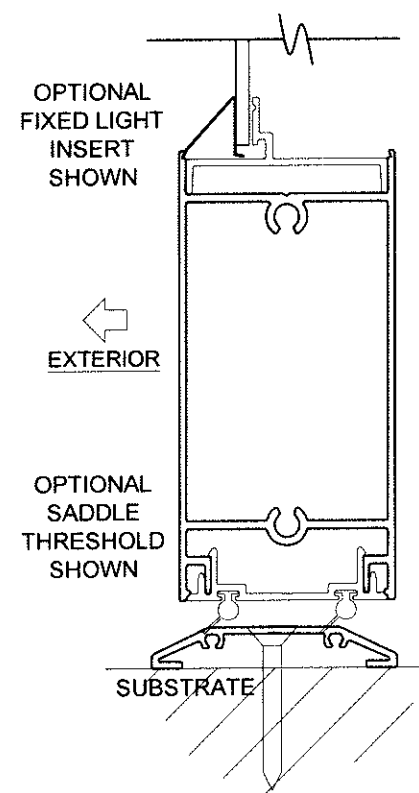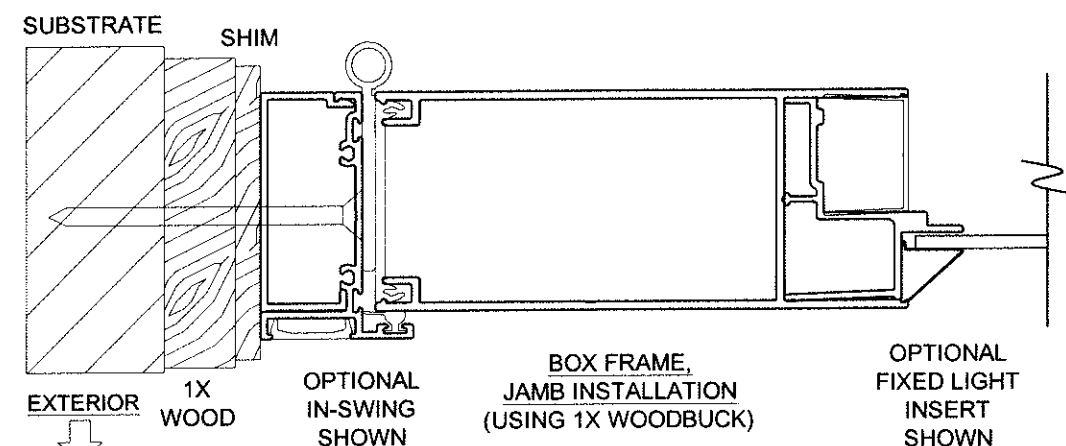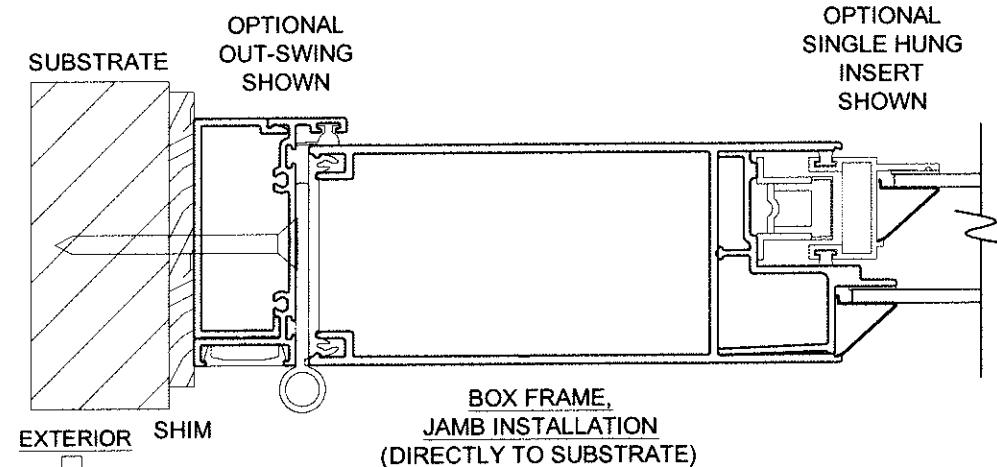

1070 TECHNOLOGY DRIVE NOKOMIS, FL 34275 FL CERT. OF AUTH. : 29296	Drawn By:	Date:	Material:	THE INFORMATION, DESIGN OR DATA CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF PGT INDUSTRIES AND CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO PORTION OF THIS DOCUMENT MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT THE EXPRESSED WRITTEN PERMISSION OF PGT INDUSTRIES.
	J. ROSOWSKI	09/30/11	ALUMINUM 6063-T6	
	Revised By:	Date:	Revisions:	
	Description:			
Title:				Rev:
CABANA DOOR INSTALLATION				
Series/Model:	Scale:	Sheet:	Drawing No.	
A. Lynn Miller, P.E. P.E. #58705	CD-290	NTS	2 of 3	1093011JR

INSTALLATION WITH Z-BAR FRAME




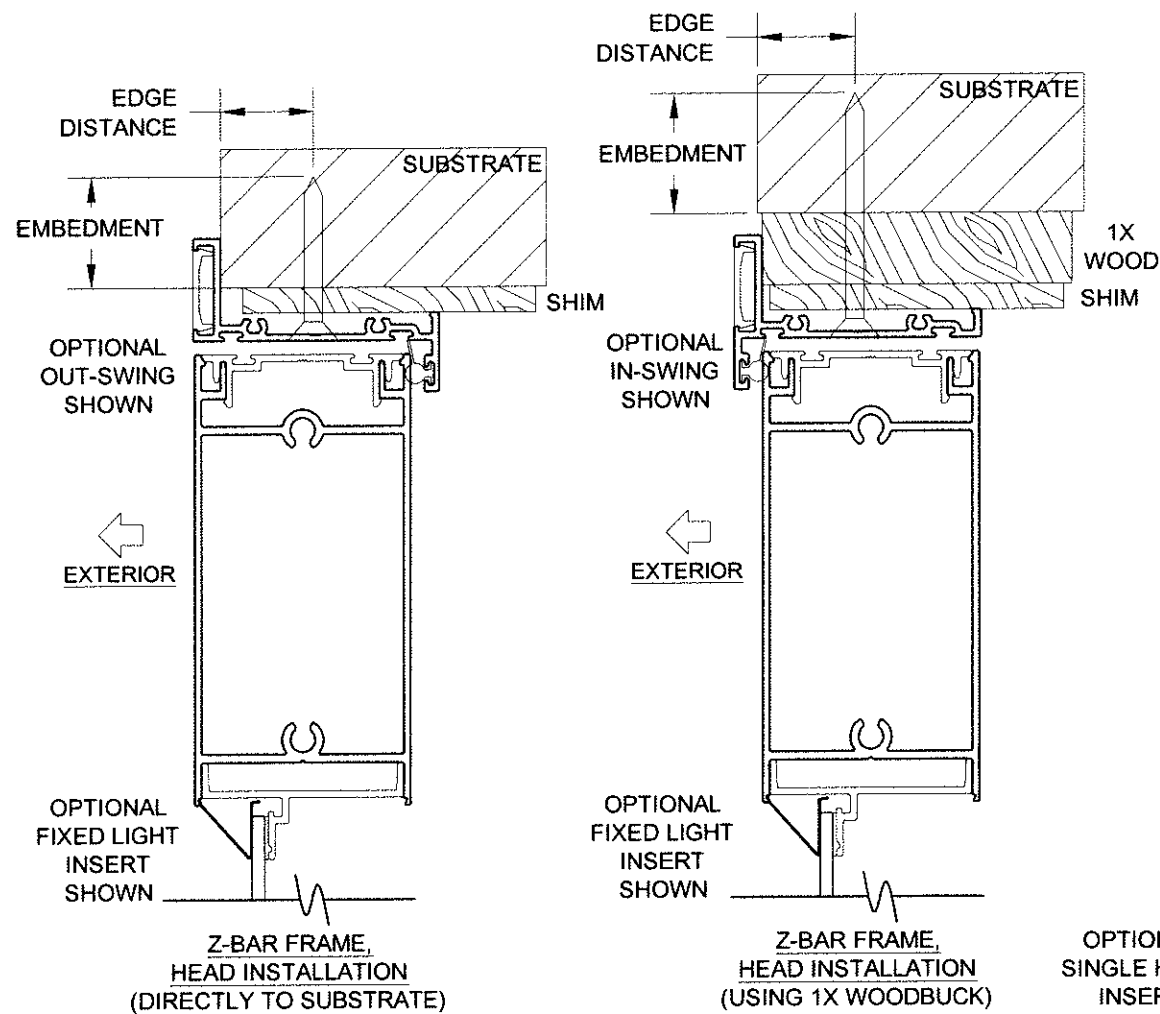


TABLE 3: HARDWARE (ALL FRAME TYPES)

Part #	Description
7CDSP	Lock Strike Plate
6FLATM	Striker Backing Plate
7CDSPDB	Deadbolt Strike Plate
78516XS	#8-32 x .375 Ph. Fl. S.S.
4UBLOK	Lock Support Assy.
7634FW	#6 x .750 Ph. Fl. SMS
7CDSP	Lock Strike Plate (Active Slab)
6FLATM	Striker Backing Plate (Active Slab)
7CDSPDB	Deadbolt Strike Plate (Active Slab)
78516XS	#8-32 x .375 Ph. Fl. S.S. (Active Slab)
6CDRIMW	Rim Foam Insert - 3 3/8"
7DEAD	Deadbolt/Knob (Active)
7KNOBQ	Knob Set (Inactive)
7CDKLOKB	Deadbolt/Knob - Polished Brass (Active)
7DBLKB	Double Lockset
69333W	Hinge
41704	Hinge Pin Cap
41705	Hinge Pin Bushing
7XXXOM	Hinge Pin
7VT45	Hinge Rivet
7834FPTW	#8 x .750 Ph. Fl. TEK SMS

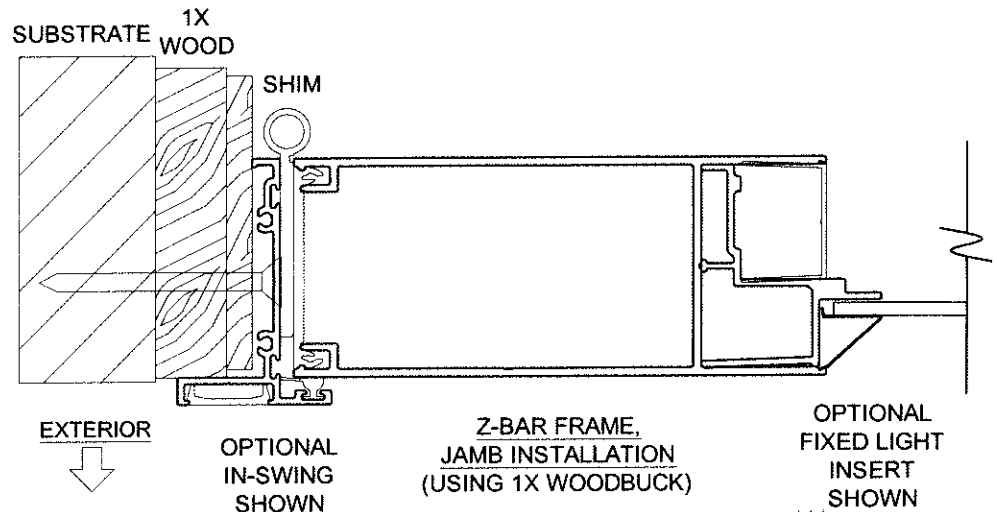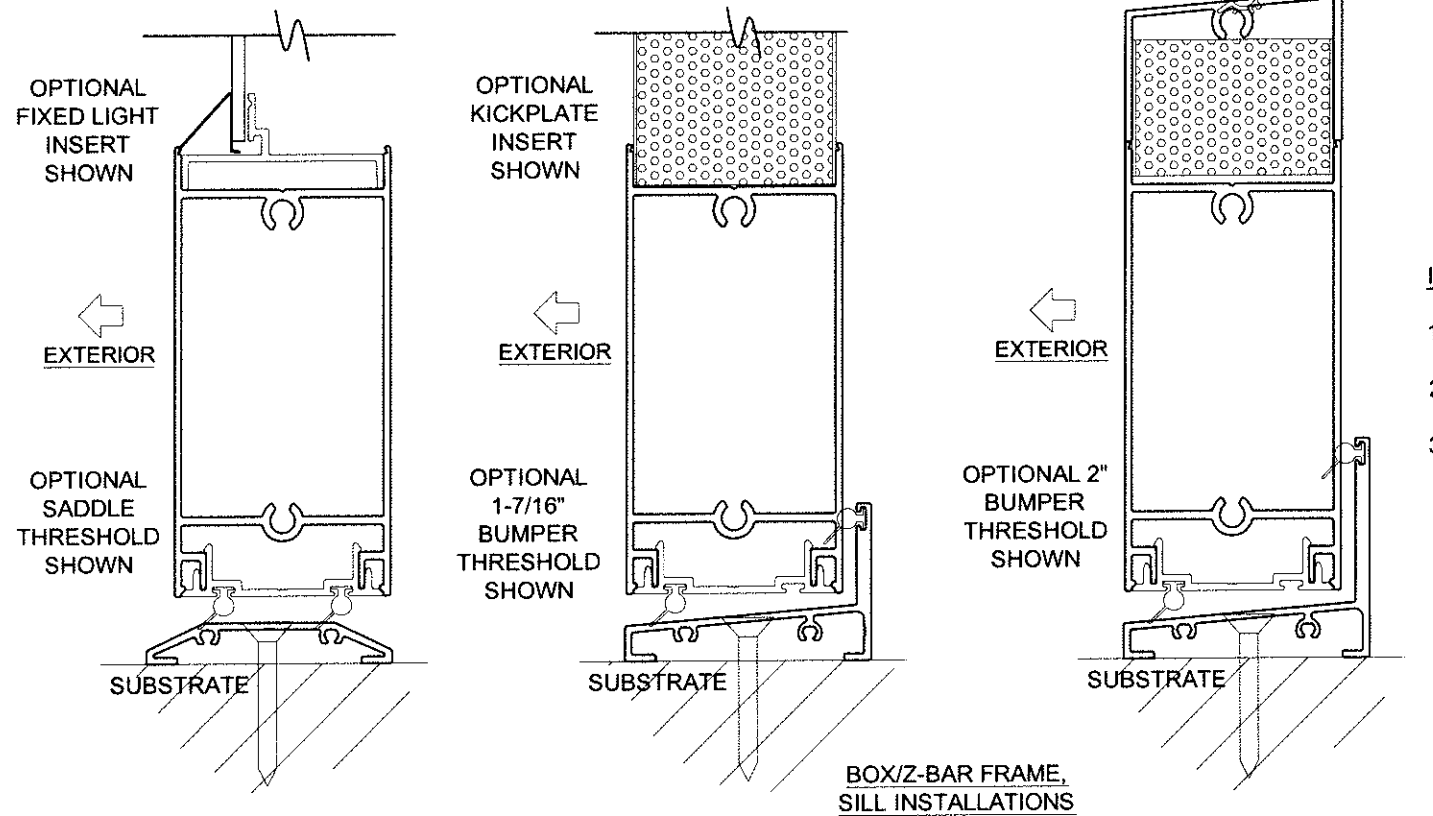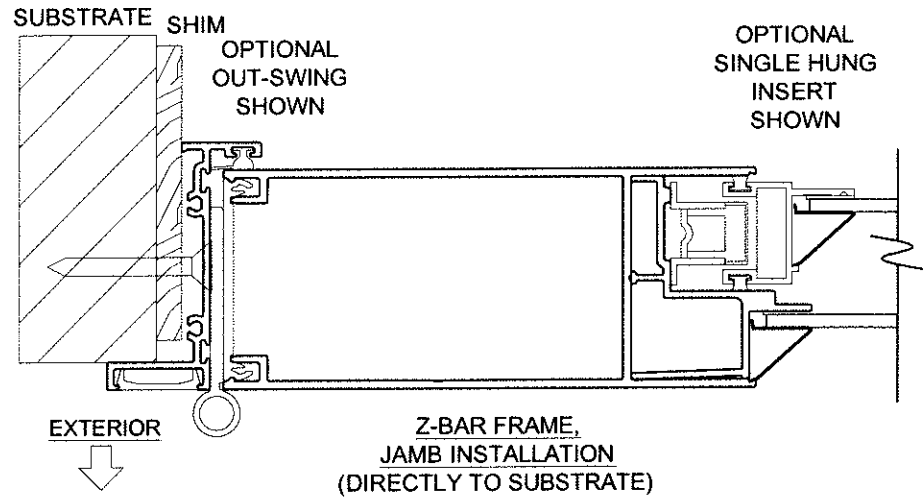

INSTALLATION NOTES:

- 1) SEE SHEET 1 FOR SPACING REQUIREMENTS.
- 2) SEE TABLE 1 FOR ANCHORAGE AND SUBSTRATE REQUIREMENTS.
- 3) MAX. SHIM THICKNESS TO BE 1/4".

PGT 1070 TECHNOLOGY DRIVE NOKOMIS, FL 34275 FL CERT. OF AUTH. : 29296 A. Lynn Miller, P.E. P.E. #58705	Drawn By: J. ROSOWSKI	Date: 09/30/11	Material: ALUMINUM 6063-T6	THE INFORMATION, DESIGN OR DATA CONTAINED HEREIN IS THE EXCLUSIVE PROPERTY OF PGT INDUSTRIES AND CONSIDERED CONFIDENTIAL AND PROPRIETARY. NO PORTION OF THIS DOCUMENT MAY BE USED OR REPRODUCED IN ANY FORM WITHOUT THE EXPRESSED WRITTEN PERMISSION OF PGT INDUSTRIES.
	Revised By:	Date:	Revisions:	
	Description:			
	Title: CABANA DOOR INSTALLATION			
Series/Model: CD-290	Scale: NTS	Sheet: 3 of 3	Drawing No. 1093011JR	Rev:

