



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

PGT Industries, Inc.
1070 Technology Drive
North Venice, Fl. 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION:

Series "FD-455 Vinyl" Outswing VE 2000 Tan 202 lighter shades (Non-White and White) Rigid Cellular PVC Door w/ Sidelites and w/Transoms - N.I.

APPROVAL DOCUMENT: Drawing No. MD-455.1, Series titled "Vinyl French Door and SLT/ TR", sheets 01 through 12 of 12, dated 05/07/13 with the latest revision dated 11/27/13, prepared by manufacture, signed and sealed by Anthony Lynn Miller, P. E., bearing the Miami-Dade County Product Control Section Approval stamp with the Notice of Acceptance number and Approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
1/23/14

NOA No. 13-0815.04
Expiration Date: January 23, 2019
Approval Date: January 23, 2014
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **MD-455.1**, Series titled "Vinyl French Door and SLT/ TR", sheets 01 through 12 of 12, dated 05/07/13 with the latest revision dated 11/27/13, prepared by manufacture, signed and sealed by Anthony Lynn Miller, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of an outswing PVC French door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7370**, dated 05/23/13, signed and sealed by Jorge A. Naya, Jr., P. E.
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of a PVC fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7370**, dated 05/23/13, signed and sealed by Jorge A. Naya, Jr., P. E.
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of a PVC fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7338**, dated 05/25/13, signed and sealed by Jorge A. Naya, Jr., P. E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC-2010**, prepared by manufacture, dated 08/09/13, signed and sealed by Anthony Lynn Miller, P. E.
2. Glazing complies with **ASTM E1300-04/ 09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 13-0815.04
Expiration Date: January 23, 2019
Approval Date: January 23, 2014

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. 13-1121.01 issued to **Vision Extrusions Limited** for their series **"VE 2000 Tan 202 and lighter shades (Non-White) Rigid Cellular PVC Exterior Extrusions for Windows and Doors"** dated 01/23/14, expiring on 01/23/19.
2. Notice of Acceptance No. 13-1121.02 issued to **Vision Extrusions Limited** for their series **"White Rigid Cellular PVC Exterior Extrusions for Windows and Doors"** dated 01/23/14, expiring on 01/23/19.
3. Quanex Part **Super Spacer Standard** complying with ASTM C518 Thermal Conductivity 0.881 BTU-in/ hr.-ft²-°F, ASTM F 1249 WVTR-Pass, ASTM D3985 Oxygen-Pass, ASTM E 2190 I.G. Durability-No Fog-Pass.
4. Quanex Part **Duraseal** complying with ASTM C518 Thermal Conductivity 2.22 BTU-in/ hr.-ft²-°F, ASTM F 1249 WVTR-Pass, ASTM D 1434 Argon Permeance-Pass, ASTM E 2189 I.G. Durability-No Fog, ASTM E 546 Dew Point Development -20°F in 48 hrs.
5. PVC-AAMA 303-13, Voluntary Specification for Rigid Polyvinyl Chloride (PVC) Exterior Profiles for Vision Extrusions, Ltd.-VEX-1 by AAMA Fenestration Exterior Profile Certification Program.

F. STATEMENTS

1. Statement letter of conformance and complying with **FBC-2010**, issued by manufacture, dated 08/09/13, signed and sealed by Anthony Lynn Miller, P. E.
2. Statement letter of no financial interest, issued by manufacture, dated 08/09/13, signed and sealed by Anthony Lynn Miller, P.E.
3. Proposal No. **13-0079R** issued by Product Control, dated 04/04/13, signed by Jaime D. Gascon, P. E.
4. Laboratory compliance letter for Test Reports No.'s **FTL-7370** and **FTL-7338**, issued by Fenestration Testing Laboratory, Inc., dated 05/23/13, signed and sealed by Jorge A. Naya, Jr., P. E.
5. Proposal No. **13-0079** issued by Product Control, dated 01/31/13, signed by Jaime D. Gascon, P. E.

G. OTHERS

1. None.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 13-0815.04
Expiration Date: January 23, 2019
Approval Date: January 23, 2014

GENERAL NOTES: SERIES 455,
NON-IMPACT-RESISTANT, VINYL, REINFORCED, OUTSWING
FRENCH DOOR & SIDELITE/TRANSOM (SLT/TR)

1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).

2) SHUTTERS ARE REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS.

3) FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS (CMU'S OF NORMAL WEIGHT AND OF COMPRESSIVE STRENGTH OF MIN. 1.9 KSI) AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.

4) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 1, THIS SHEET. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.

5) IF SILL IS TIGHT TO SUBSTRATE, GROUT IS NOT REQUIRED. IF USED, NON-SHRINK, NON-METALLIC GROUT AT 3.4 KSI MIN. PER ASTM C1107, (DONE BY OTHERS). MAX. 1/4" SHIM SPACE FOR GROUT WHICH MUST FULLY SUPPORT THE ENTIRE LENGTH OF THE SILL THAT IS NOT TIGHT TO THE SUBSTRATE, AND TRANSFER SHEAR LOAD TO SUBSTRATE. IF SUBSTRATE IS WOOD, 30# FELT PAPER OR MASTIC IS REQUIRED BETWEEN THE GROUT AND WOOD SUBSTRATE, OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION, COMPLYING WITH THE FBC.

6) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE THE EMBEDMENT SHOWN ON TABLE 1, THIS SHEET. NARROW JOINT SEALANT IS USED ON ALL FOUR CORNERS OF THE FRAME. EXTERIOR INSTALLATION ANCHORS SHOULD BE SEALED. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.

7) MAX. 1/4" SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS. WOOD BUCKS, BY OTHERS, MUST BE SUFFICIENTLY ANCHORED TO RESIST LOADS IMPOSED ON THEM BY THE DOOR, SIDELITE OR TRANSOM.

8) DESIGN PRESSURES:
A. NEGATIVE DESIGN LOADS BASED ON STRUCTURAL TEST PRESSURE, FRAME ANALYSIS AND GLASS PER ASTM E1300.
B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL TEST PRESSURE, FRAME ANALYSIS AND GLASS PER ASTM E1300.

9) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.

10) ALL RIGID AND CELLULAR PVC MANUFACTURED BY VISION EXTRUSIONS, LTD. HAS BEEN TESTED TO COMPLY WITH THE FLORIDA BUILDING CODE FOR PLASTICS.

11) SIZES MUST BE VERIFIED FOR COMPLIANCE WITH EGRESS REQUIREMENTS PER THE FLORIDA BUILDING CODE.

12) REFERENCES:
TEST REPORTS: FTL-7338 & 7370
NOA'S: ELCO ULTRAON NOA; ELCO CRETEFLEX NOA; ELCO AGGRE-GATOR NOA;
VISION EXTRUSIONS, LTD. WHITE, TAN & BROWN-COATED RIGID PVC NOA'S (10-0420.06, 11-0902.10 & 12-1017.01) VISION EXTRUSIONS, LTD. WHITE & NON-WHITE RIGID CELLULAR PVC NOA'S (13-1121.01 & 13-1121.02), ANSI/AF&PA NDS FOR WOOD CONSTRUCTION AND ADM ALUMINUM DESIGN MANUAL.

DESIGN PRESSURE RATING	IMPACT RATING
VARIES, SEE SHEETS 4 & 5	NOT RATED FOR MISSILE IMPACT RESISTANCE

TABLE 1:

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment
A	3/16" Elco Ultracon	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
		UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
B	#10 Steel SMS (G5) #10 410 S.S. SMS #10 18-8 S.S. SMS	P.T. Southern Pine (SG=0.55)	1/2"	1-3/8"
		Aluminum, 6063-T5*	5/16"	0.056"
		Steel, A36*	5/16"	0.056"
		Steel Stud, A653 Gr. 33*	5/16"	0.056" (16 Ga)
	3/16" Elco Ultracon	P.T. Southern Pine (SG=0.55)	1/2"	1-3/8"
		Grouted CMU, (ASTM C-90)	2-1/2"	2-1/4"
		Concrete (min. 2.85 ksi)	1"	1-3/8"
	1/4" Elco Ultracon	UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
		P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
	C	Aluminum, 6063-T5*	3/8"	0.063"
		Steel, A36*	3/8"	0.056"
		Steel Stud, A653 Gr. 33*	3/8"	0.056" (16 Ga)
	1/4" Elco Ultracon	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Grouted CMU, (ASTM C-90)	2-1/2"	1-3/4"
		Concrete (min. 2.85 ksi)	1"	1-3/8"
	1/4" Elco 410 S.S. CreteFlex	Concrete (min. 3.35 ksi)	1"	1-3/4"
		UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" Elco 18-8 S.S. Aggre-Gator	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Concrete (min. 3.27 ksi)	1-1/2"	1-3/8"
		UngROUTED CMU, (ASTM C-90)	4"	1-1/4"
D	1/4" Elco Ultracon	Concrete (min. 2.85 ksi)	2-1/2"	1-3/8"
	1/4" Elco410 S.S. CreteFlex	Concrete (min. 3.35 ksi)	2-1/2"	1-3/4"

* MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE.

TABLE 2:

Type #	Description
1	1/8" Tempered - 5/8" Airspace - 1/8" Tempered
2	3/16" Tempered - 1/2" Airspace - 3/16" Tempered



SEE TABLE 10 FOR SPACER INFORMATION.

GUIDE TO SHEETS:



GENERAL NOTES.....	1
ELEVATIONS.....	2
GLAZING DETAILS.....	3
DESIGN PRESSURES.....	4-5
SIDELITE/TRANSOM ANCHORS.....	4-6
INSTALLATION.....	7-9
EXTRUSION PROFILES.....	10
PARTS LIST.....	11
CORNER DETAILS.....	11
HARDWARE DETAILS.....	12

Approved as complying with the
Florida Building Code
Date 11/23/2014
NOA# 13-0815.04
Miami Dade Product Control
By *[Signature]*

Rev 1	
Rev 2	
Rev 3	

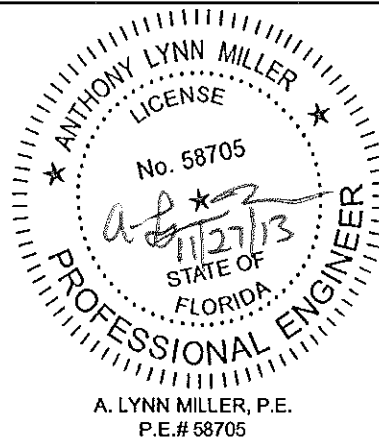1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	5/7/13 Date	J ROSOWSKI By	MD-455.1	Rev.
				No.
				DWG
 CERT. OF AUTH. #29296	VINYL FRENCH DOOR AND SLT/TR	GENERAL NOTES	1 OF 12	Sheet
				Scale
				NTS
	FD-455	Series	Desc.	Title

EXAMPLE CONFIGURATIONS

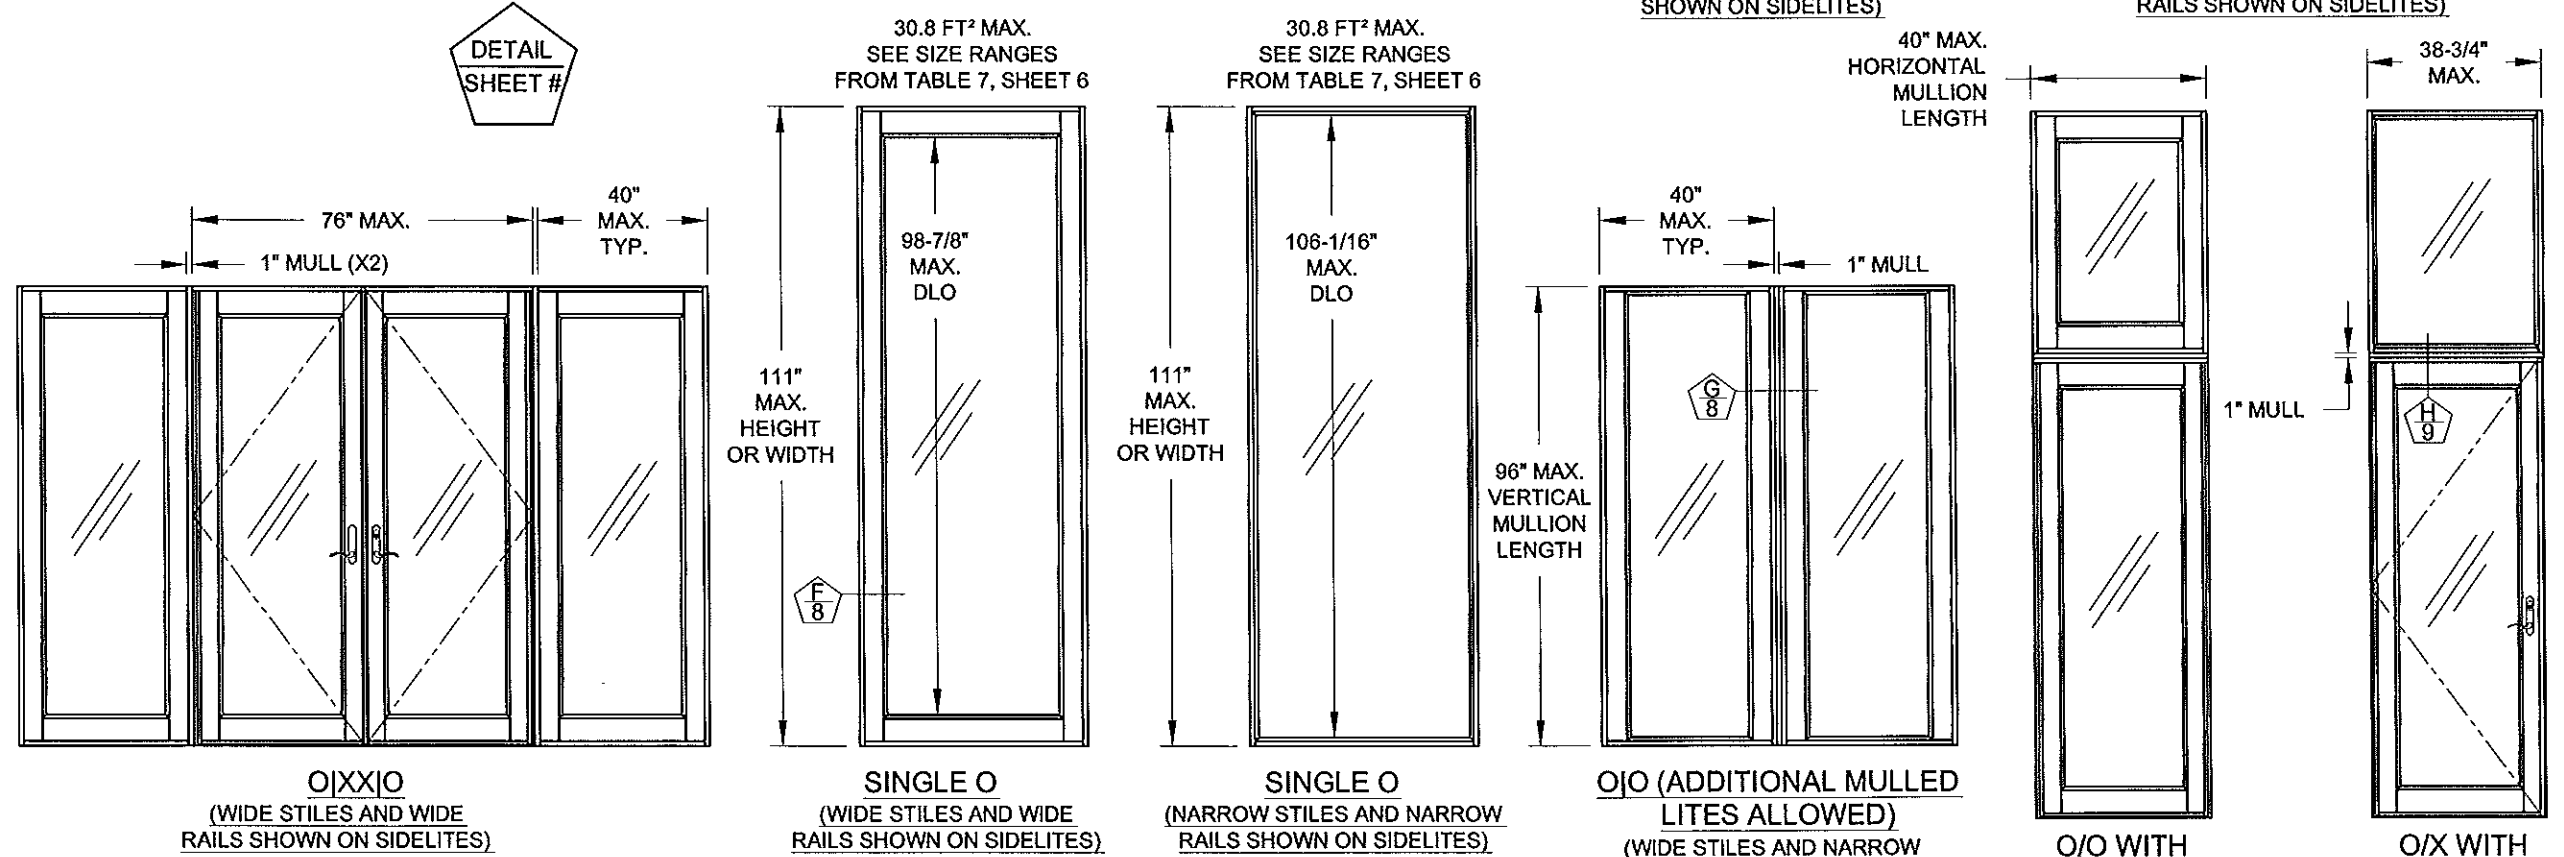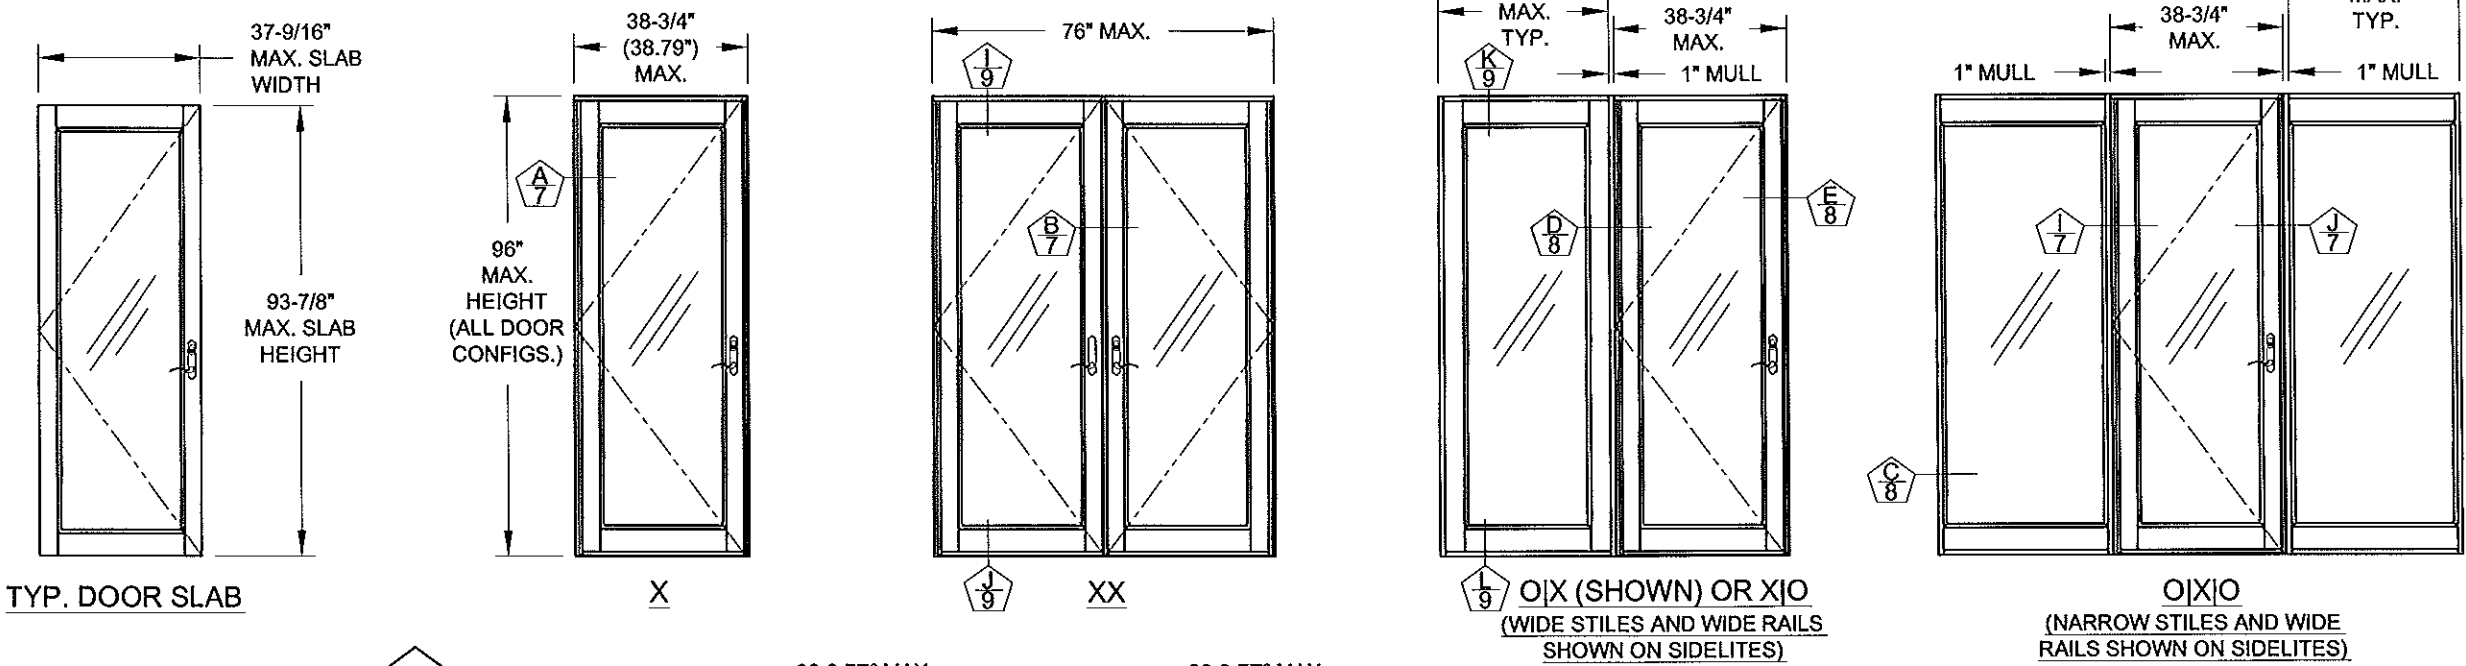


- NOTES:
- 1) SINGLE DOORS MAY BE LEFT OR RIGHT-HANDED.
 - 2) MULLIONS SHOWN ARE STANDARD 1" FRENCH DOOR MULLIONS PER THIS NOA.
 - 3) MULLED CONFIGURATIONS NOT SHOWN MAY BE POSSIBLE USING OTHER MULLION TYPES, SEE SEPARATE NOA.
 - 4) FRENCH DOOR MULLION IS LIMITED TO 96" IN VERTICAL APPLICATIONS AND 40" IN HORIZONTAL APPLICATIONS.
 - 5) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SLT/TR OR MULLED ASSEMBLY.
 - 6) ADDITIONAL CONFIGURATIONS USING THE 1" FRENCH DOOR MULLION ARE POSSIBLE. USE THE ABOVE DRAWINGS AS A REFERENCE FOR SIZE LIMITATIONS.


Approved as complying with the
Florida Building Code
Date 01/23/2014
NOA# 13-0815.04
Miami Code Product Control
By [Signature]

Rev 1	
Rev 2	
Rev 3	


1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	Date 5/7/13	By J ROSOWSKI	Rev.
			MD-455.1
			No.
			DWG
VINYL FRENCH DOOR AND SLT/TR EXAMPLE CONFIGURATIONS	Sheet 2 OF 12	Scale NTS	FD-455
			Series
			Desc.
			Title

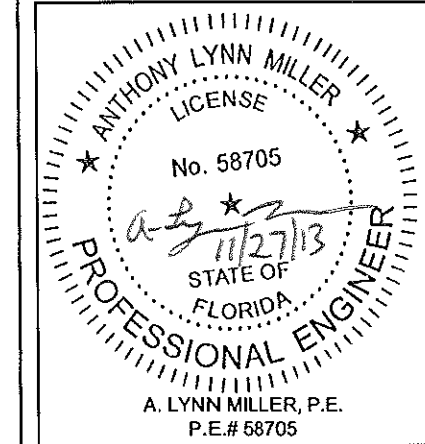


DOOR, SIDELITE & TRANSOM GLAZING DETAILS

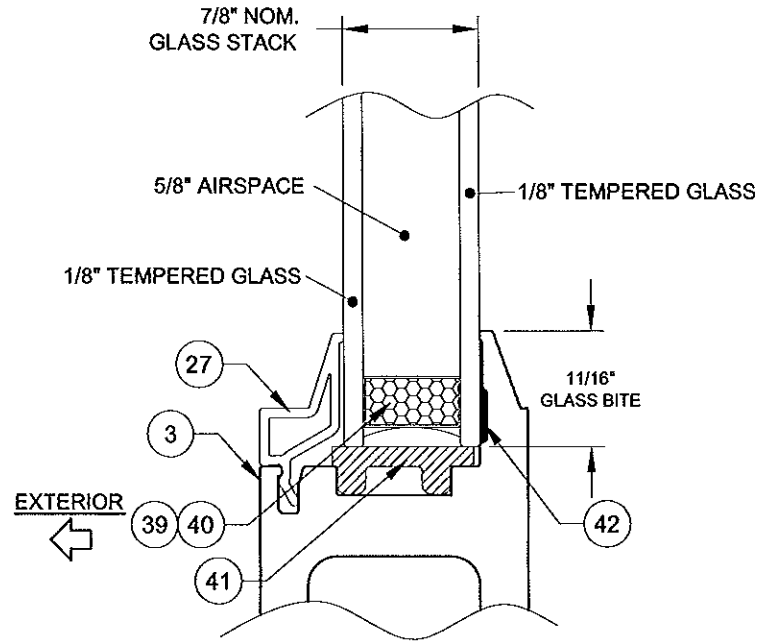


GLASS TYPE 1

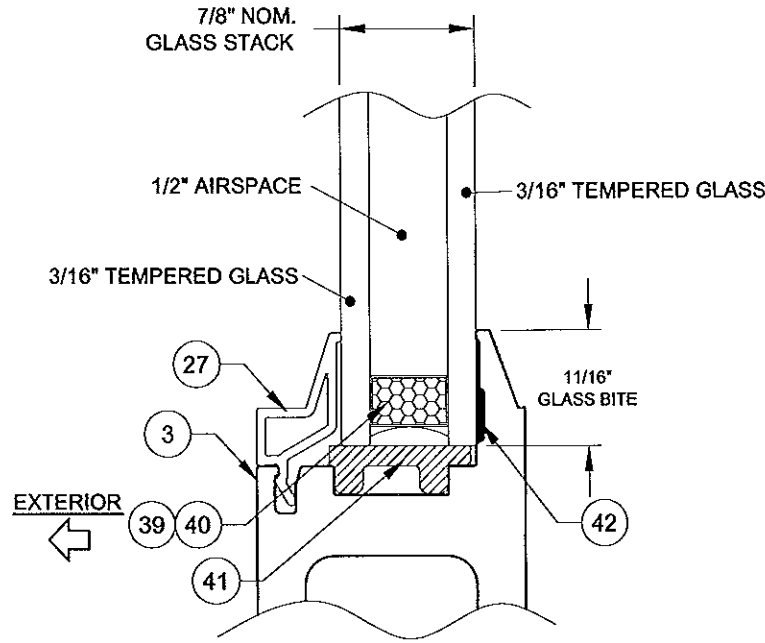

GLASS TYPE 2

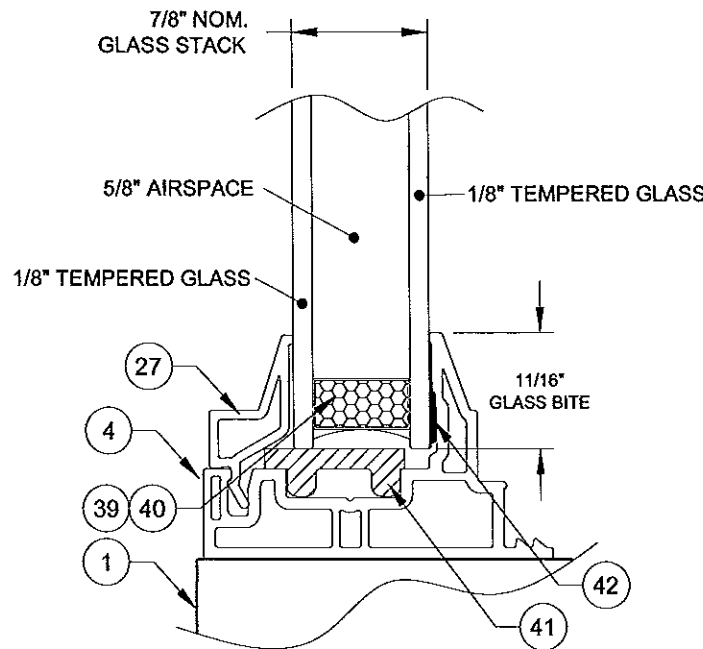


GLASS TYPE 1
SHOWN IN SIDELITE ADAPTER

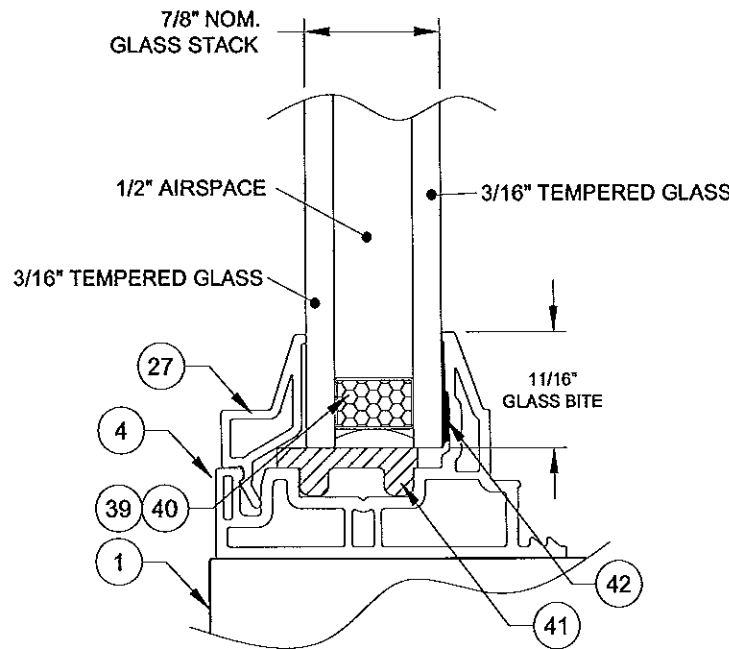


GLASS TYPE 2
SHOWN IN SIDELITE ADAPTER

Approved as complying with the
Florida Building Code
Date 11/23/2014
NOA# 13-0815.04
Miami Dade Product C
By [Signature]

Rev 1	
Rev 2	
Rev 3	

		1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	
CERT. OF AUTH. #29296		Date	
VINYL FRENCH DOOR AND SLT/TR		5/7/13	
GLAZING DETAILS		By	J ROSOWSKI
Drawn	DWG No.	MD-455.1	Rev.
FD-455	3 OF 12		
Scale	NTS		

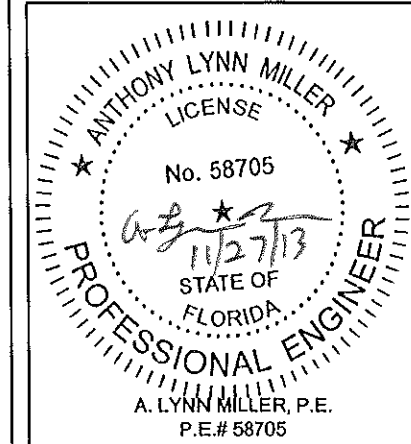

SINGLE DOOR INSTALLATION (X)

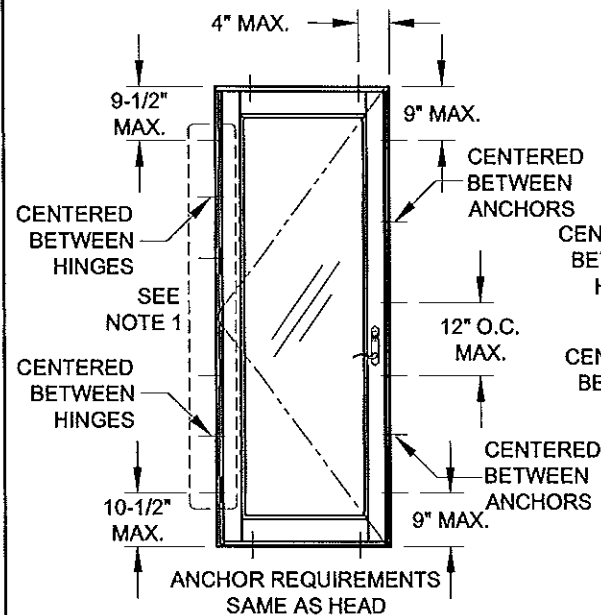


TABLE 3:
DOOR DESIGN PRESSURE

+/-50.0 PSF	Glass Type 1
+/-70.0 PSF	Glass Type 2

DOUBLE DOOR INSTALLATION (XX)

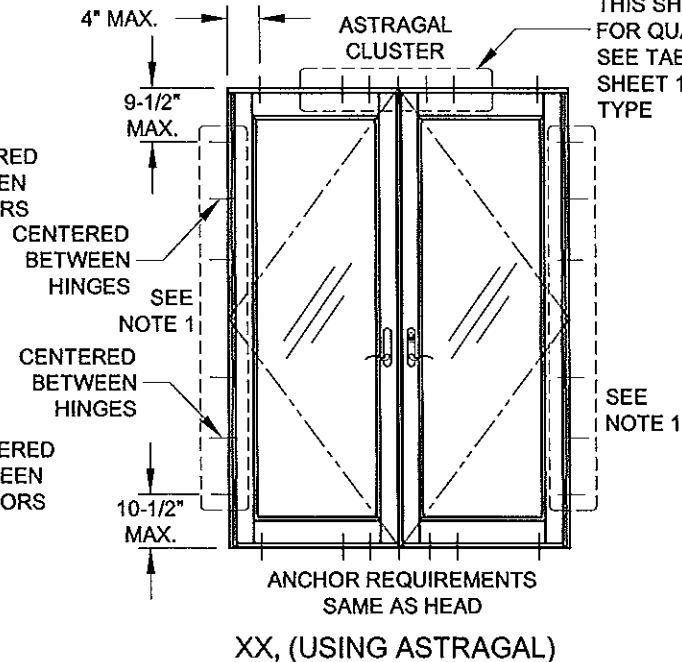


TABLE 4:
XX Door: Astragal Cluster Anchors Required @ Head & Sill

Door Height (in)	Door Width (in)							
	48	60	72	76	80	84	88	92
80	4	4	4	5	4	5	4	4
96	4	5	4	6	4	6	5	4

SIDELITE-TO-SIDELITE MULLION INSTALLATION (O|O, O|O|O, ETC.)

4" O.C. MIN., SEE TABLE 4, THIS SHEET, FOR QUANTITY, SEE TABLE 1, SHEET 1 FOR TYPE

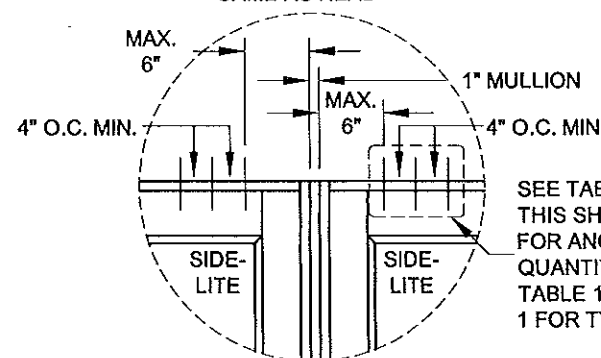
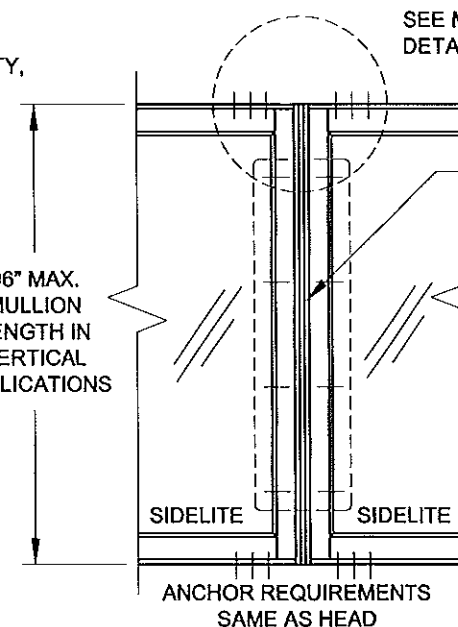


TABLE 5:
VERTICAL MULLION DESIGN PRESSURE

+/-70.0 PSF

SIDELITE-TO-DOOR MULLION INSTALLATION (X|O, O|X, X|X, O|X|O, X|O|X, O|XX|O, ETC)

SEE MULLION CLUSTER DETAIL BELOW

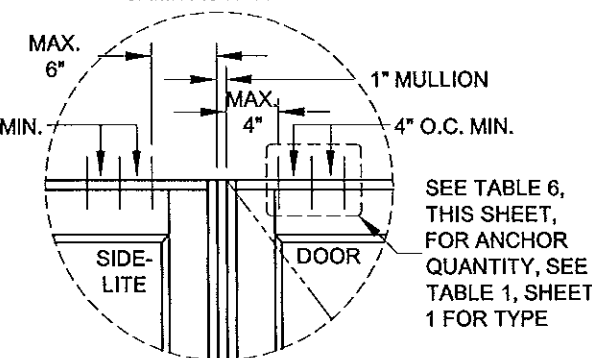
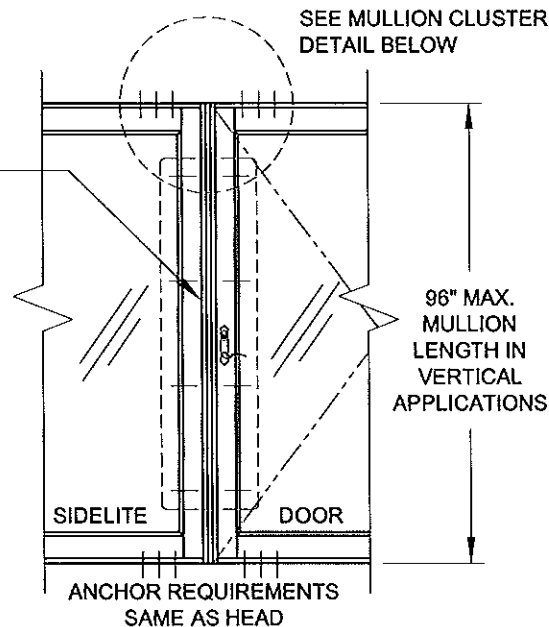


TABLE 6:
Anchors Required for a Vertical Mullion (each mullion end)

Mullion Height (in)	Door or Sidelite/Transom Width (in)											
	12	24	32	38-3/4	40	48	60	72	84	96	108	120
Door	N/A	2	2	2	2	2	2	2	2	2	2	2
SLT/TR	N/A	2	2	2	2	2	2	2	2	2	2	2
Door	N/A	2	2	2	2	2	2	2	2	2	2	2
SLT/TR	N/A	2	2	2	2	2	2	2	2	2	2	2

FOR "O|XX|O" AND SIMILAR CONFIGURATIONS CONTAINING A DOUBLE DOOR (XX), USE ONLY HALF OF THE FRAME WIDTH OF THE DOUBLE DOOR WHEN USING THIS TABLE.

TRANSOM-TO-DOOR (X/O) OR TRANSOM-TO-SIDELITE (O/O) MULLION ATTACHMENT & INSTALLATION

ATTACH DOORS, SIDELITES & TRANSOMS TO THE MULLION AS PER THE INSTRUCTION OF THE INDIVIDUAL PRODUCT

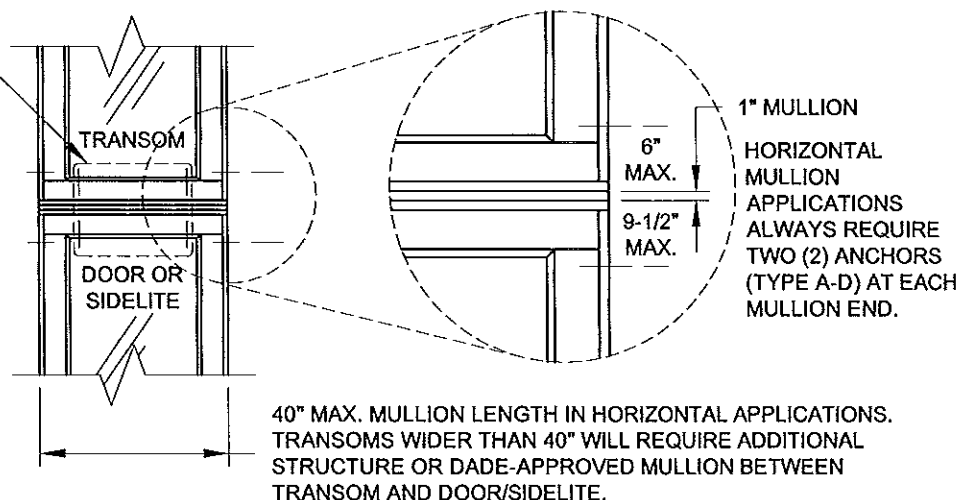


TABLE 7:
HORIZONTAL MULLION DESIGN PRESSURE

+/-70.0 PSF

INSTRUCTIONS:

- 1) DOOR HINGE JAMBS OF ALL HEIGHTS TO ALWAYS BE ANCHORED WITH SIX ANCHORS. SEE TABLE 1, SHEET 1, FOR ALL APPROVED ANCHORS. FOUR OF THE SIX ANCHORS MUST BE INSTALLED THROUGH THE HINGES, ONE AT EACH HINGE LOCATION (RECOMMENDED #10 FLATHEAD SMS OR 3/16" FLATHEAD ULTRACON FOR EACH HINGE ANCHOR).
- 2) FOR A MULLED UNIT, DETERMINE THE DESIGN PRESSURE OF EACH COMPONENT IN THAT CONFIGURATION. FOR EXAMPLE, ON AN "X|O" CONFIGURATION, THE DP FOR THE DOOR, THE MULLION AND THE SIDELITE MUST EACH BE DETERMINED. THE LOWEST DP APPLIES TO THE ENTIRE ASSEMBLY.

NOTES:

- 1) SINGLE DOOR MAY BE LEFT OR RIGHT-HANDED.
- 2) MULLIONS SHOWN ARE STANDARD 1" FRENCH DOOR MULLIONS.
- 3) MULLED CONFIGURATIONS NOT SHOWN MAY BE POSSIBLE USING OTHER MULLION TYPES, SEE SEPARATE NOA.
- 4) THE LOWEST COMPONENT DP IS TO BE THE OVERALL ASSEMBLY DP.
- 4) FRENCH DOOR MULLION IS LIMITED TO 96" IN VERTICAL APPLICATIONS AND 40" IN HORIZONTAL APPLICATIONS.
- 5) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SIDELITE/TRANSOM OR MULLED ASSEMBLY.
- 6) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.

Approved as complying with the Florida Building Code
Date 01/23/2014
NOA# 13-0815.04
By [Signature]

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941) 480-1600	5/7/13 Date	J ROSOWSKI By	MD-455.1 DWG No.	4 OF 12 Sheet	NTS Scale	FD-455 Series
--	----------------	------------------	---------------------	------------------	--------------	------------------



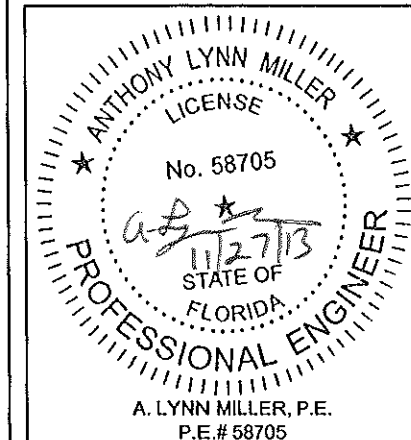


TABLE 8:

		Sidelite/Transom Design Pressure (+/-, psf) for Glass Types 1 & 2															
		Long Side (in)															
		63-3/16	66-5/8	68	70	72	76	78	82	84	88	109-1/2	96	98	104	108	111
Short Side (in)	24	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	28	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	32	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	36	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	38-3/4	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	40	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	42	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	44	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.6	+/-68.6	+/-67.7	+/-67.3			
	46	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.4	+/-68.7	+/-67.6	+/-66.5	+/-65.6				
	48	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.9	+/-69.1	+/-67.6	+/-67	+/-65.8	+/-64.7					
	50	+/-70	+/-70	+/-70	+/-70	+/-70	+/-68.4	+/-67.6	+/-66	+/-65.4	+/-64.1						
	52	+/-70	+/-70	+/-70	+/-70	+/-69.1	+/-67.1	+/-66.2	+/-64.6	+/-63.9							
	54	+/-70	+/-70	+/-70	+/-69.2	+/-68	+/-65.9	+/-65	+/-63.4								
	56	+/-70	+/-70	+/-69.7	+/-68.3	+/-67.1	+/-64.9	+/-63.9									
	58	+/-70	+/-70	+/-69	+/-67.6	+/-66.3	+/-64										
	60	+/-70	+/-69.6	+/-68.5	+/-67	+/-65.6											
	62	+/-70	+/-69.2	+/-68	+/-66.5												
	63-3/16	+/-70	+/-69.1	+/-67.9	+/-66.2												
	66-5/8	+/-69.1	+/-68.9														

NOTES:
1) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SIDELITE/TRANSOM OR MULLED ASSEMBLY.
2) SIDELITE/TRANSOM MAY BE A SINGLE, STAND-ALONE UNIT.
3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.

SIDELITE/TRANSOM INSTALLATION (O)

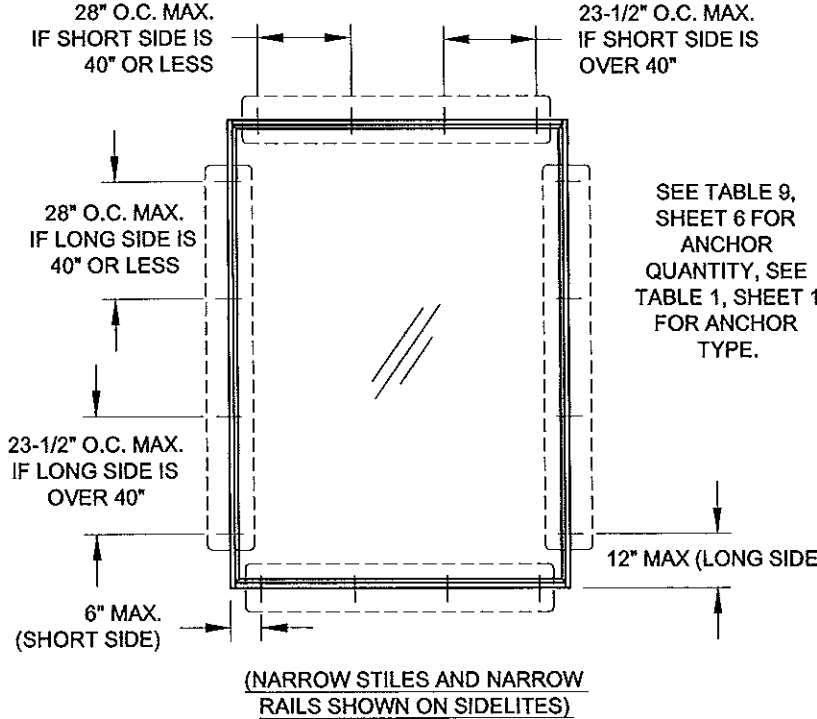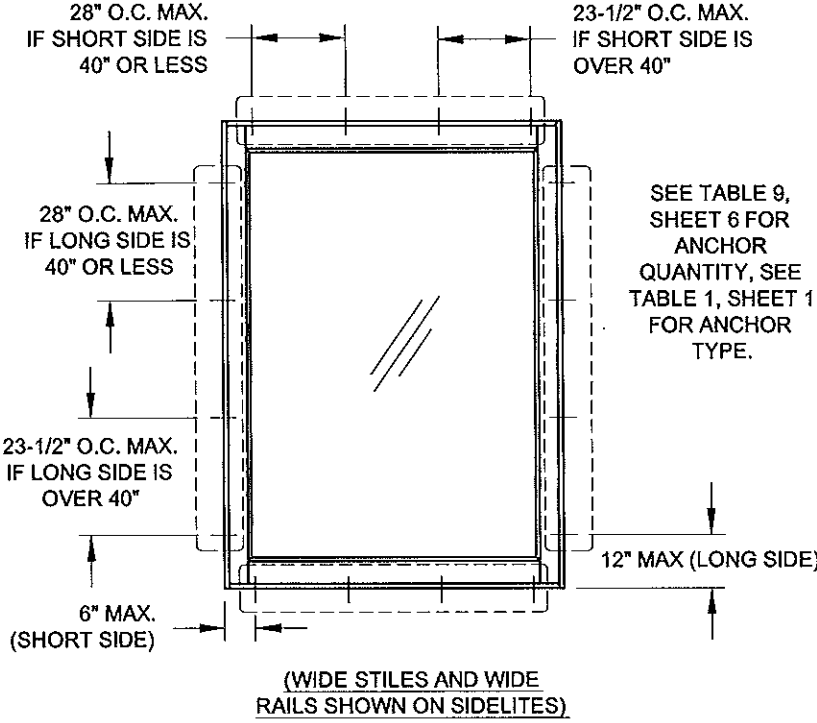

Approved as complying with the
Florida Building Code
Date 01/28/2014
NOA# 13-0815.04
Miami Dade Product Control
By [Signature]

Rev	1	2	3
Rev 1			
Rev 2			
Rev 3			

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274
(941)-480-1600

VINYL FRENCH DOOR AND SLT/TR

J ROSOWSKI

DESIGN PRESSURE 2

FD-455

5 OF 12

5/7/13

MD-455.1

Rev.

NTS

Scale

Sheet

DWG

No.

By

Date

ANTHONY LYNN MILLER
LICENSE
No. 58705
1/27/13
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

TABLE 9:


			Sidelite/Transom Anchor Quantity																																
			Long Side (in)																																
			63-3/16		66-5/8		68		70		72		76		78		82		84		88		92		96		98		104			108		111	
			Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	
Short Side (in)	24	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	5	5	5	5	5	5	5	5	5	5	5	6	5	5	6	6	6	
	28	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	4	4	4	4	4	4	4	4	5	4	5	4	5	5	5	5	5	6	5	6	5	6	5	6	5	5	7	6	7	6	
	32	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	4	4	4	4	4	4	5	4	5	4	5	4	5	5	6	5	6	5	6	5	6	5	7	5	7	5	5	7	6	8	6
	36	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
		Long Side	4	4	5	4	5	4	5	4	5	4	5	4	5	4	6	4	6	5	6	5	7	5	7	5	7	5	8	5	5	7	6	8	6
	38-3/4	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
		Long Side	4	4	5	4	5	4	5	4	5	4	6	4	6	4	6	4	6	5	7	5	7	5	7	5	8	5	8	5	5	8	6	9	6
	40	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
		Long Side	4	4	5	4	5	4	5	4	5	4	6	4	6	4	6	4	6	5	7	5	7	5	8	5	8	5	8	5	5	9	6	9	6
	42	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3				
		Long Side	5	4	5	4	5	4	5	4	5	4	6	4	6	4	6	4	7	5	7	5	7	5	8	5	8	5	8	6	5				
	44	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3						
		Long Side	5	4	5	4	5	4	5	4	6	4	6	4	6	4	7	4	7	5	7	5	7	5	8	5	8	5							
	46	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3								
		Long Side	5	4	5	4	5	4	6	4	6	4	6	4	6	4	7	4	7	5	7	5	7	5	8	5									
	48	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3											
		Long Side	5	4	5	4	5	4	6	4	6	4	6	4	6	4	7	4	7	5	7	5	7	5											
50	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3														
	Long Side	5	4	5	4	5	4	6	4	6	4	6	4	6	4	7	4	7	5	7	5														
52	Short Side	4	3	4	3	4	3	4	3	4	3	3	3	3	3	3	3	3	3																
	Long Side	5	4	5	4	6	4	6	4	6	4	6	4	6	4	7	4	7	5																
54	Short Side	4	3	4	3	4	3	4	3	4	3	4	3	4	3	4	3																		
	Long Side	5	4	5	4	6	4	6	4	6	4	6	4	6	4	7	4																		
56	Short Side	4	3	4	3	4	3	4	3	4	3	4	3	4	3																				
	Long Side	5	4	6	4	6	4	6	4	6	4	6	4	6	4																				
58	Short Side	4	3	4	3	4	3	4	3	4	3	4	3																						
	Long Side	5	4	6	4	6	4	6	4	6	4	6	4																						
60	Short Side	5	4	5	4	5	4	4	4	4	4																								
	Long Side	5	4	6	4	6	4	6	4	6	4																								
62	Short Side	5	4	5	4	5	4	5	4																										
	Long Side	5	4	6	4	6	4	6	4																										
63-3/16	Short Side	5	4	5	4	5	4																												
	Long Side	5	4	6	4	6	4																												
66-5/8	Short Side	6	4	6	4																														
	Long Side	5	4	6	4																														

NOTES:
1) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SIDELITE/TRANSOM OR MULLED ASSEMBLY.
2) SIDELITE/TRANSOM MAY BE A SINGLE, STAND-ALONE UNIT.
3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.

Approved as complying with the
Florida Building Code
Date 01/23/2014
NOAH# 13-0815.04
Miami Dade Product Control
By [Signature]

Rev 1	
Rev 2	
Rev 3	

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
P.O. BOX 1529
NOKOMIS, FL 34274
(941)-480-1600



CERT. OF AUTH. #29296

VINYL FRENCH DOOR AND SLT/TR

By J ROSOWSKI
Date 5/7/13

SLT/TR ANCHOR QUANTITIES

FD-455






6 OF 12

NTS

MD-455.1

Rev.

ANTHONY LYNN MILLER
LICENSE
No. 58705
11/27/13
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

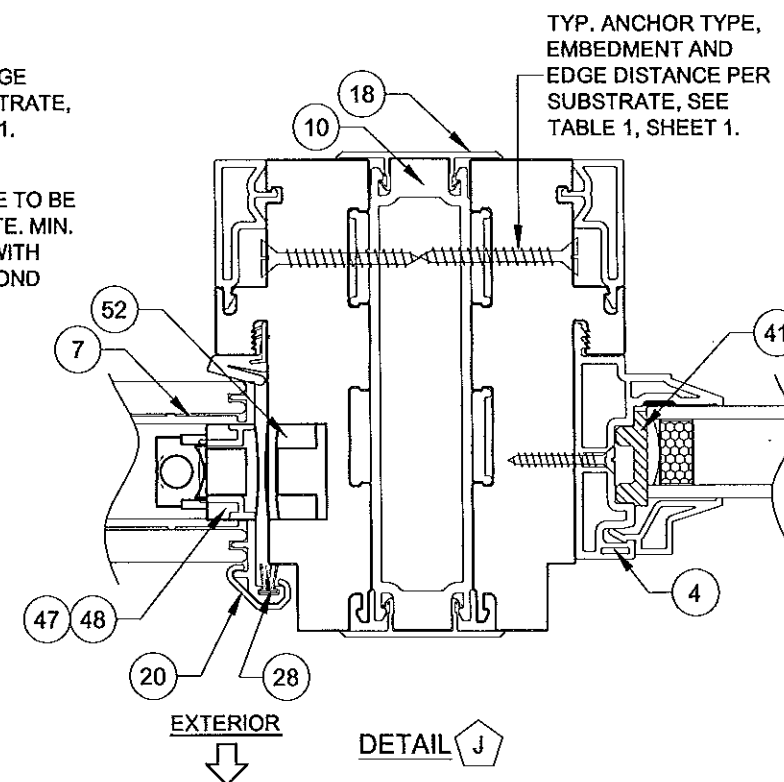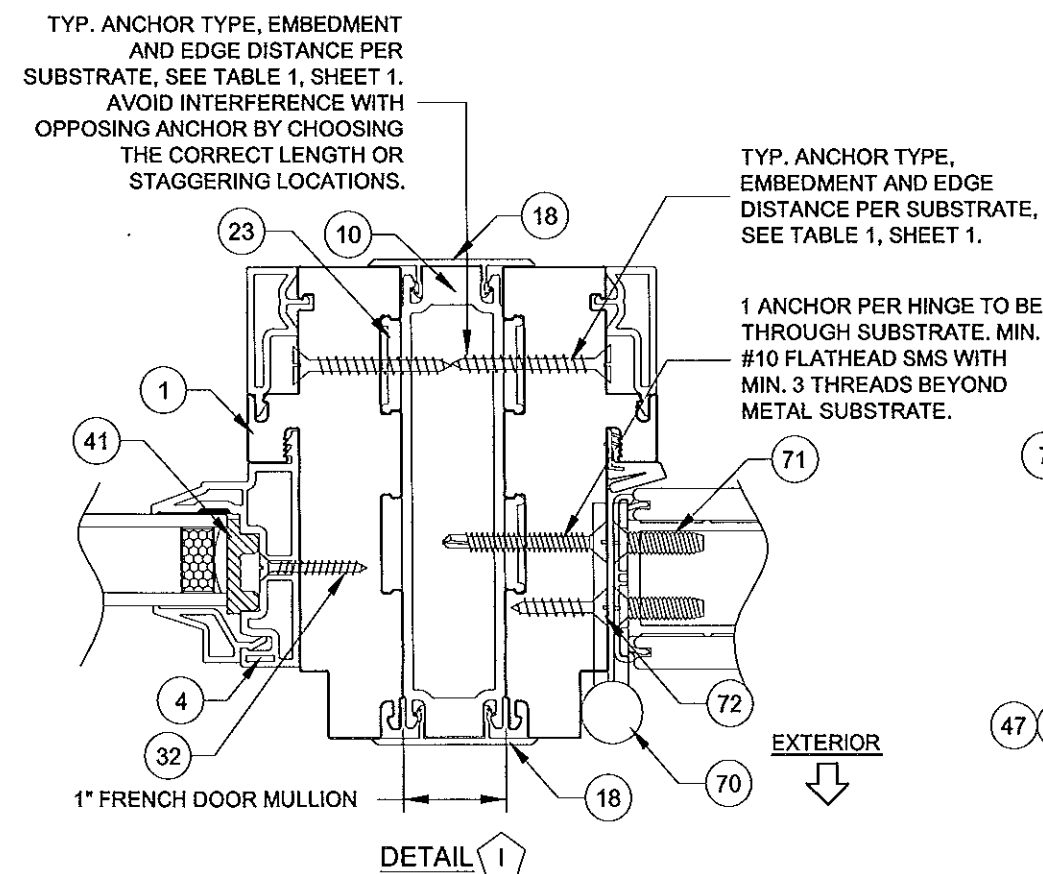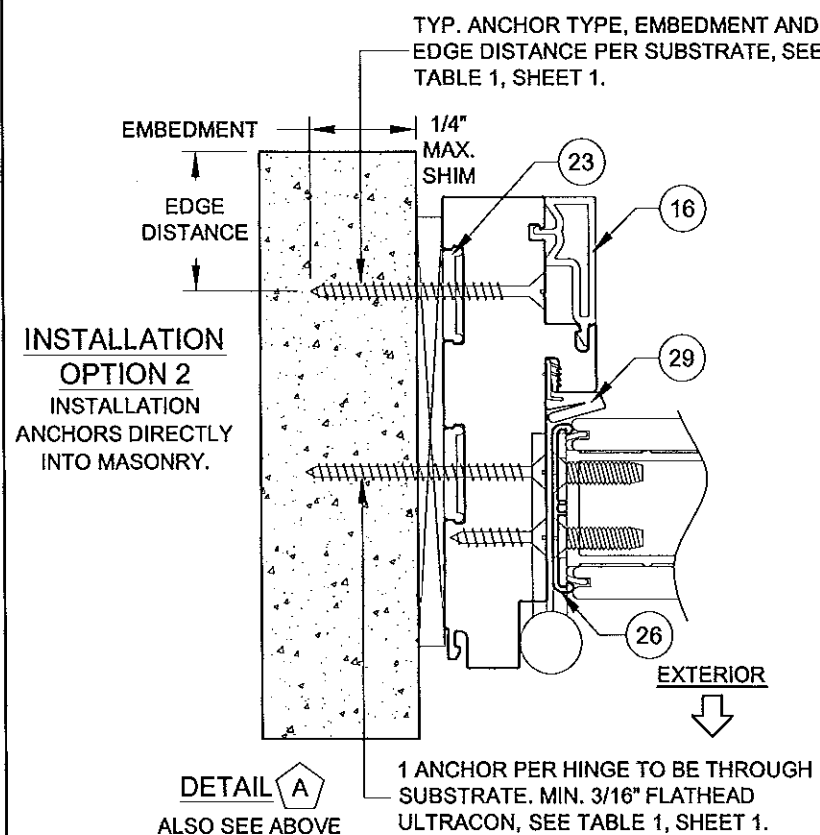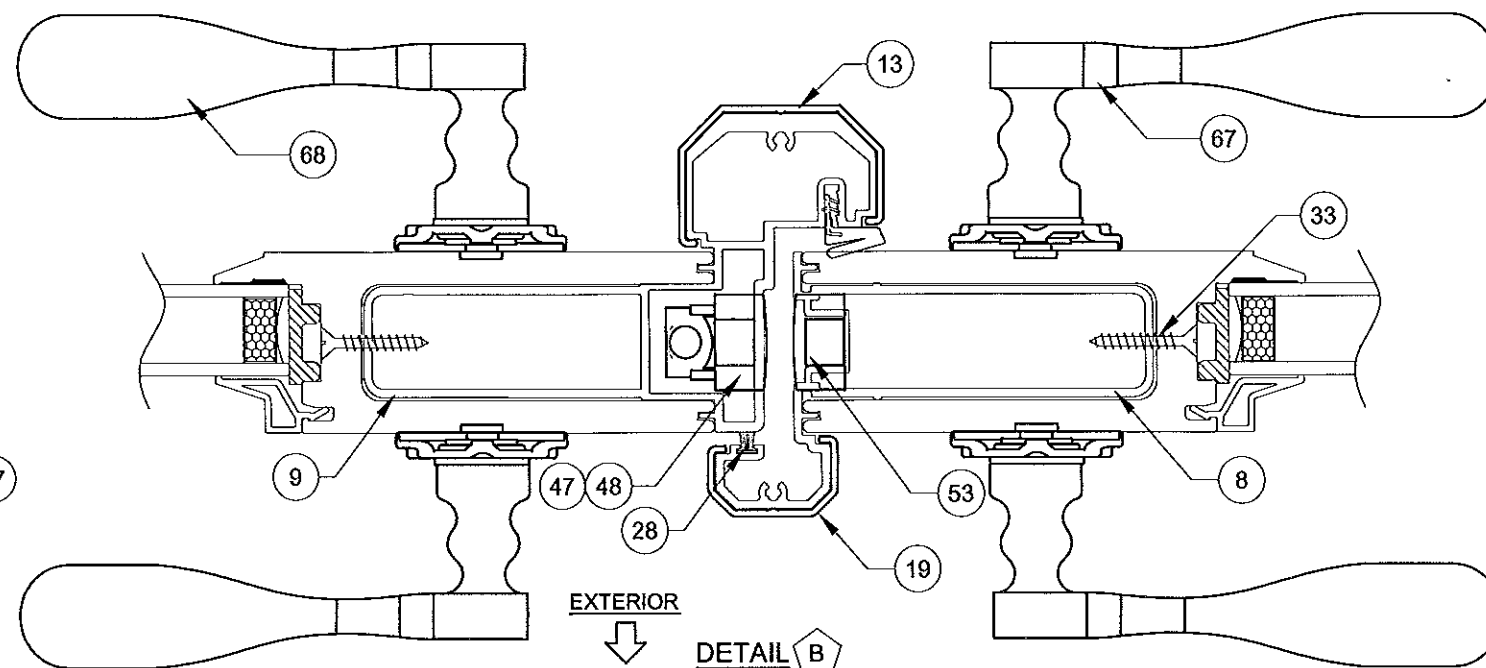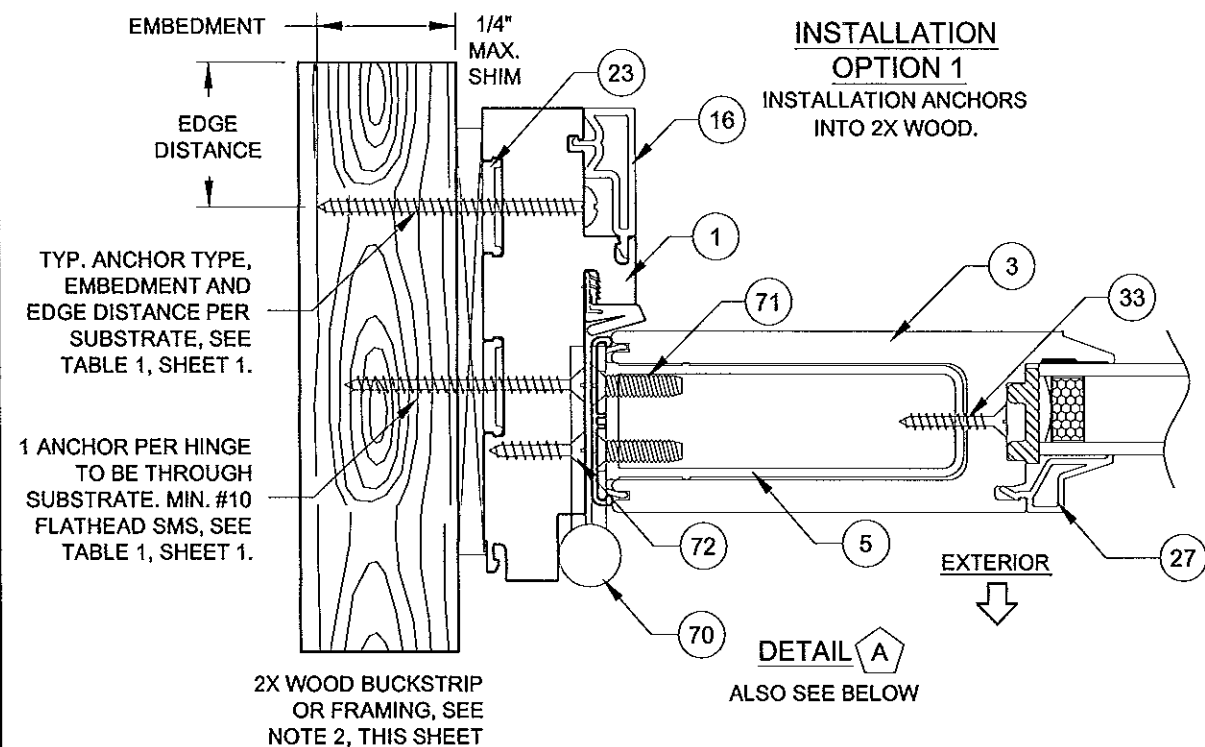


INSTALLATION NOTES:


- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 1, SHEET 1. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE DOOR, SIDELITE OR TRANSOM.
- 2) WOOD BUCKS DEPICTED ON THIS SHEET AS "1X", ARE BUCKS WHOSE TOTAL THICKNESS IS LESS THAN 1-1/2". 1X WOOD BUCKS ARE OPTIONAL IF UNIT CAN BE INSTALLED DIRECTLY TO MASONRY. WOOD BUCKS DEPICTED AS "2X" ARE 1-1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- 3) FOR ATTACHMENT TO METAL: THE STRUCTURAL MEMBER SHALL BE OF A SIZE TO PROVIDE FULL SUPPORT TO THE FRAME OF THE DOOR, SIDELITE OR TRANSOM.
- 4) IF APPLICABLE, LOWEST DESIGN PRESSURE FROM DOOR, SIDELITE, TRANSOM OR MULLION APPLIES TO THE WHOLE SYSTEM.

Approved as complying with the
Florida Building Code
Date 02/23/2014
NOAH# 13-0815.04
Miami-Dade Product Control
By [Signature]

Rev	Rev	Rev
Rev 1	Rev 2	Rev 3

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	CERT. OF AUTH. #29296 VINYL FRENCH DOOR AND SLT/TR INSTALLATION 1	FD-455 NTS Scale	7 OF 12 Sheet	MD-455.1 DWG No.	Rev

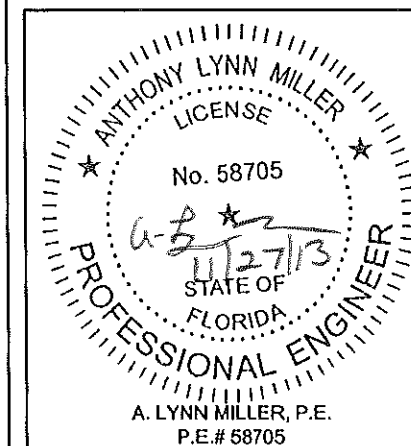

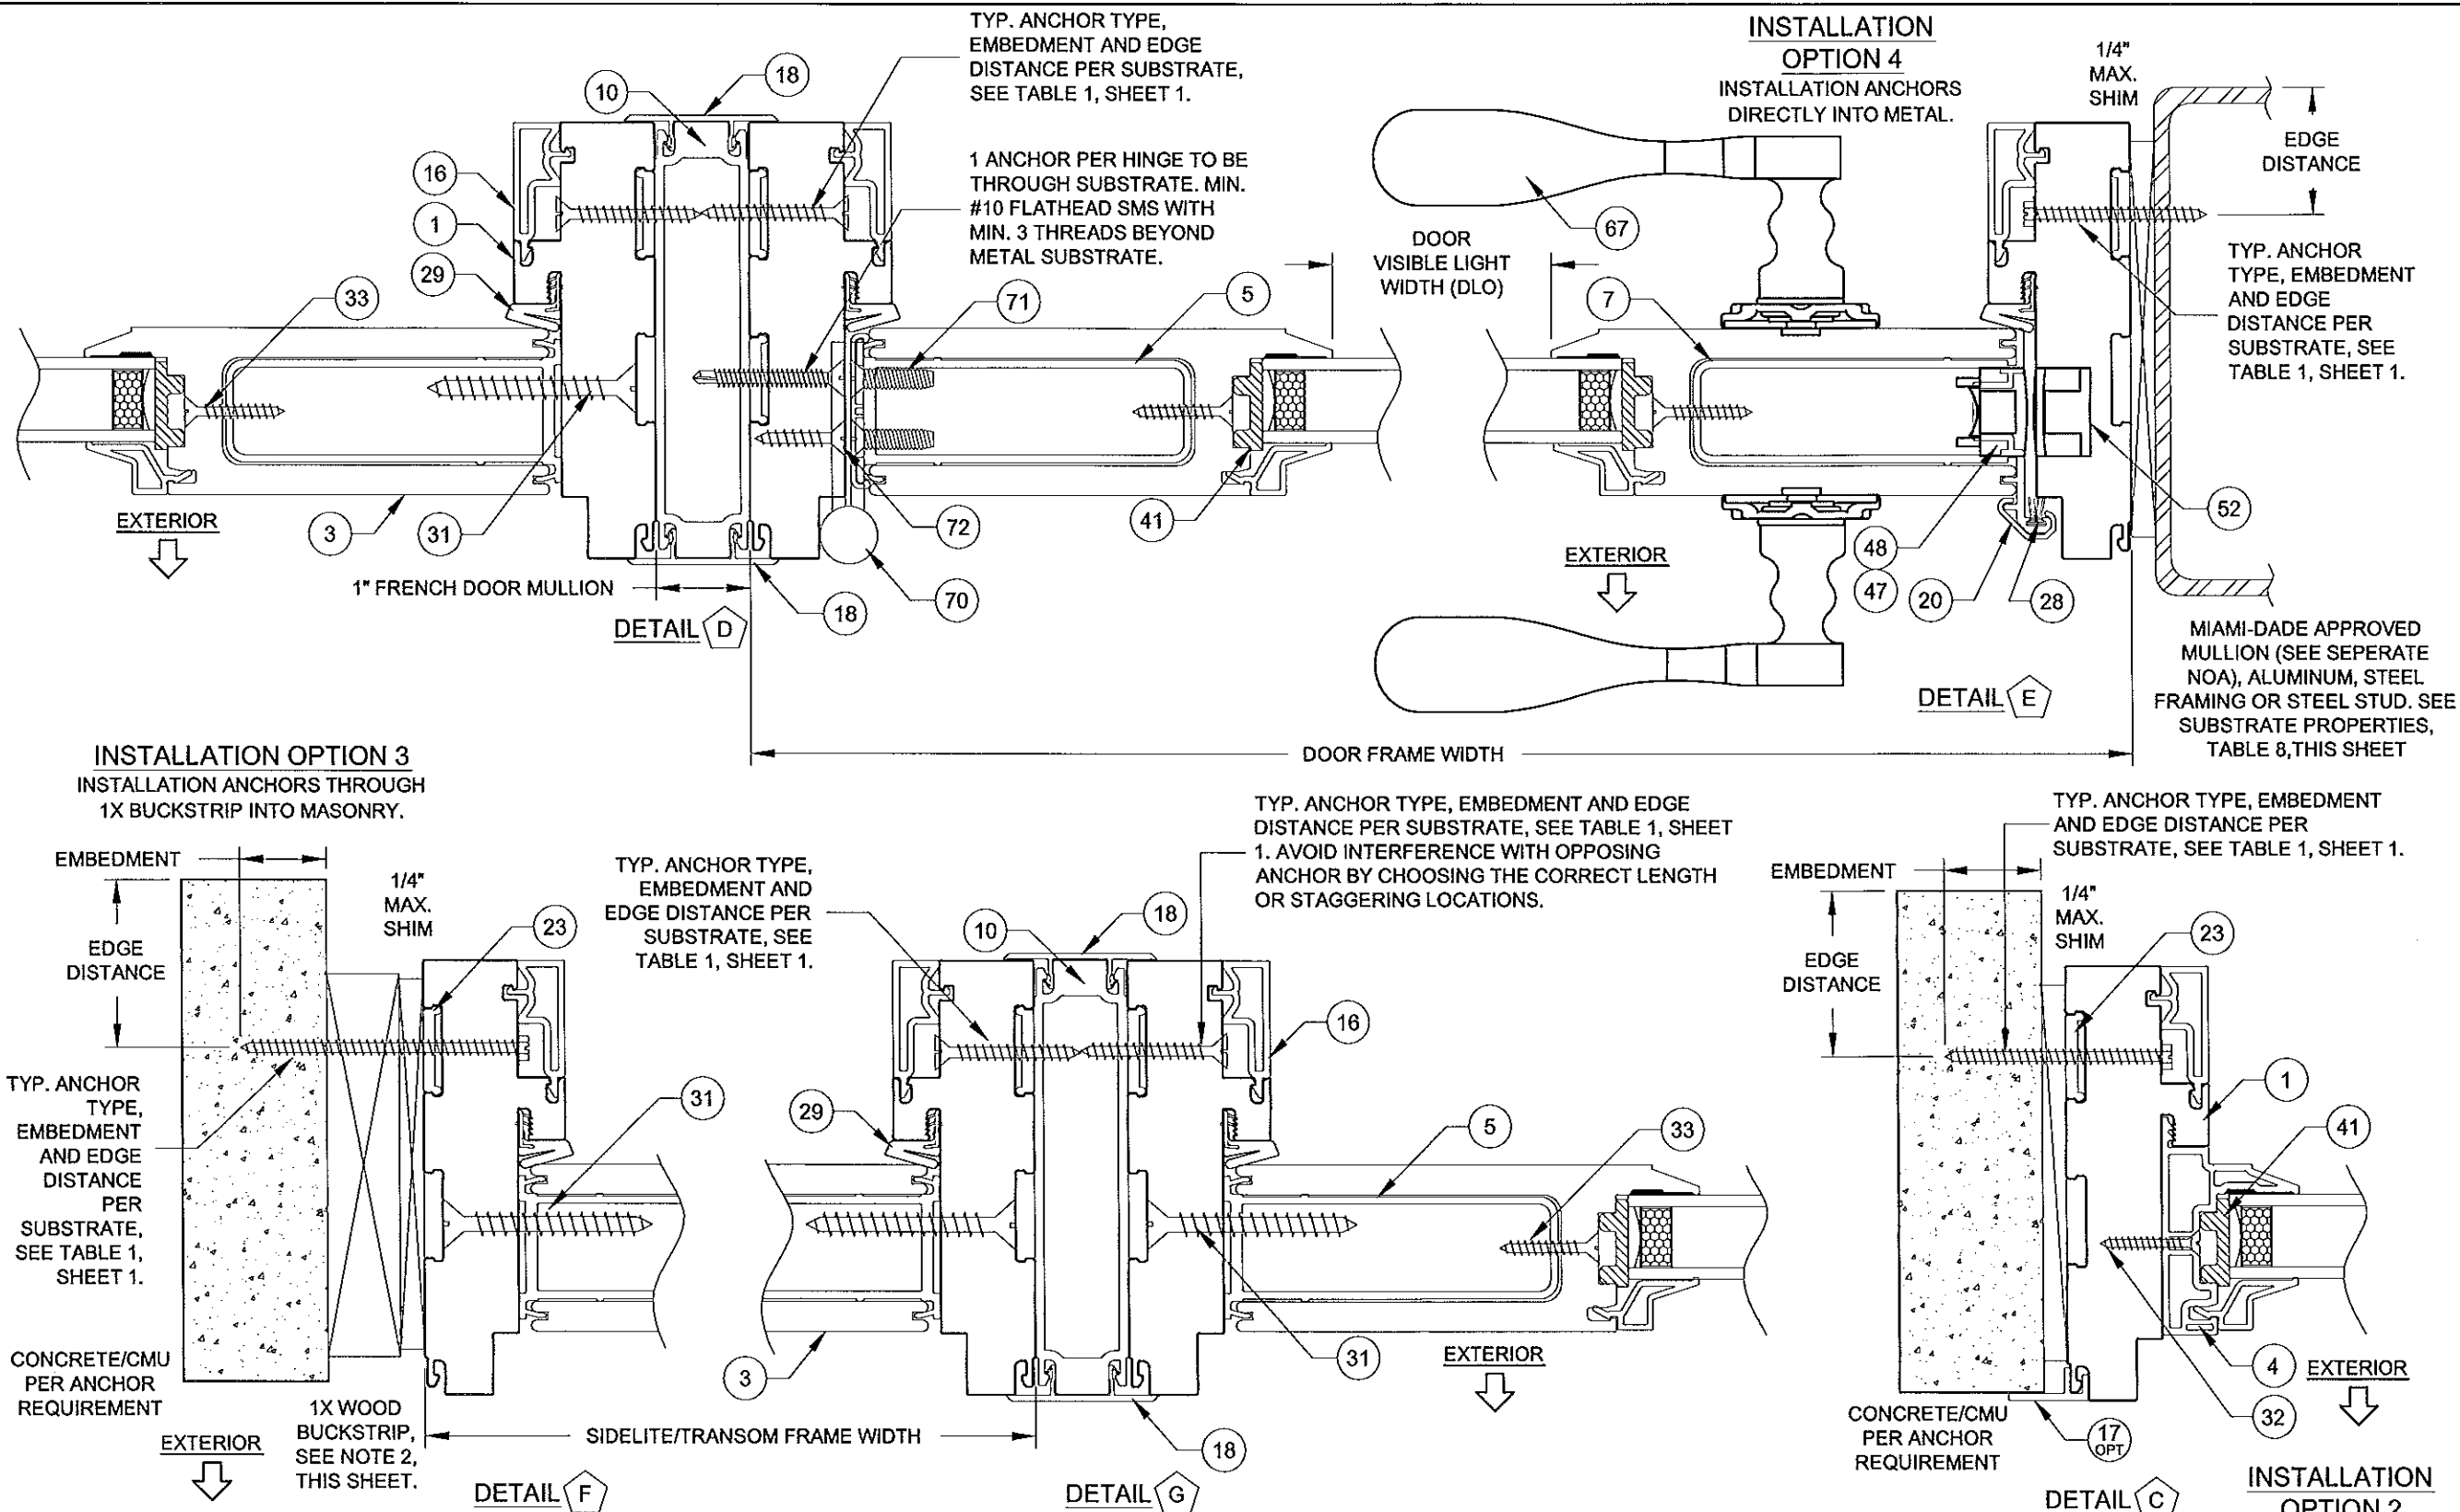


INSTALLATION NOTES:




- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 1, SHEET 1. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE DOOR, SIDELITE OR TRANSOM.
- 2) WOOD BUCKS DEPICTED ON THIS SHEET AS "1X", ARE BUCKS WHOSE TOTAL THICKNESS IS LESS THAN 1-1/2". 1X WOOD BUCKS ARE OPTIONAL IF UNIT CAN BE INSTALLED DIRECTLY TO MASONRY. WOOD BUCKS DEPICTED AS "2X" ARE 1-1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- 3) FOR ATTACHMENT TO METAL: THE STRUCTURAL MEMBER SHALL BE OF A SIZE TO PROVIDE FULL SUPPORT TO THE FRAME OF THE DOOR, SIDELITE OR TRANSOM.
- 4) IF APPLICABLE, LOWEST DESIGN PRESSURE FROM DOOR, SIDELITE, TRANSOM OR MULLION APPLIES TO THE WHOLE SYSTEM.

Approved as complying with the
Florida Building Code
Date 11/23/2014
NOA# 13-0815.04
Miami Dade Product Control
By [Signature]

Rev 1	
Rev 2	
Rev 3	



1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	5/7/13	J ROSOWSKI	Rev.
			MD-455.1
			DWG No.
			8 OF 12
RGT CERT. OF AUTH. #29296	VINYL FRENCH DOOR AND SLT/TR	INSTALLATION 2	Sheet
			NTS
			Scale
			FD-455

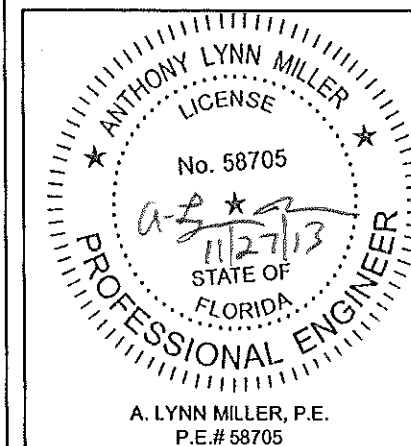

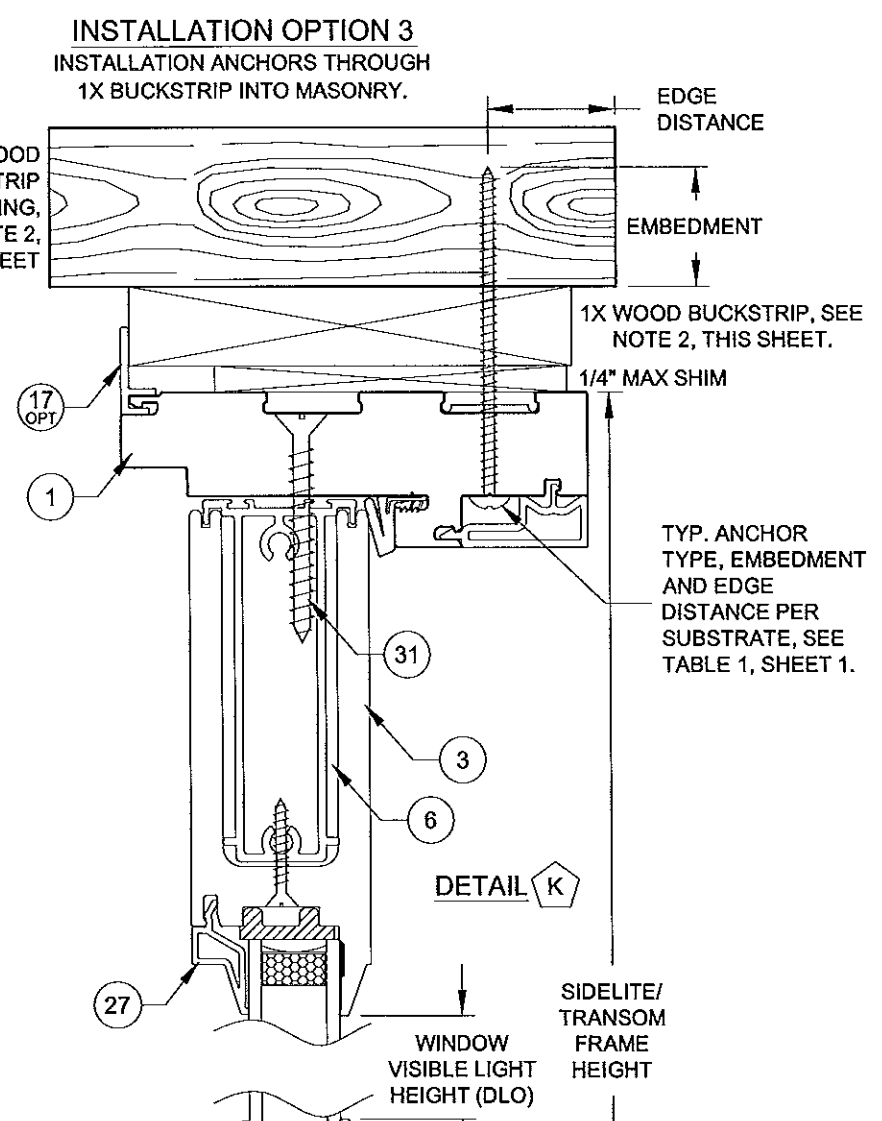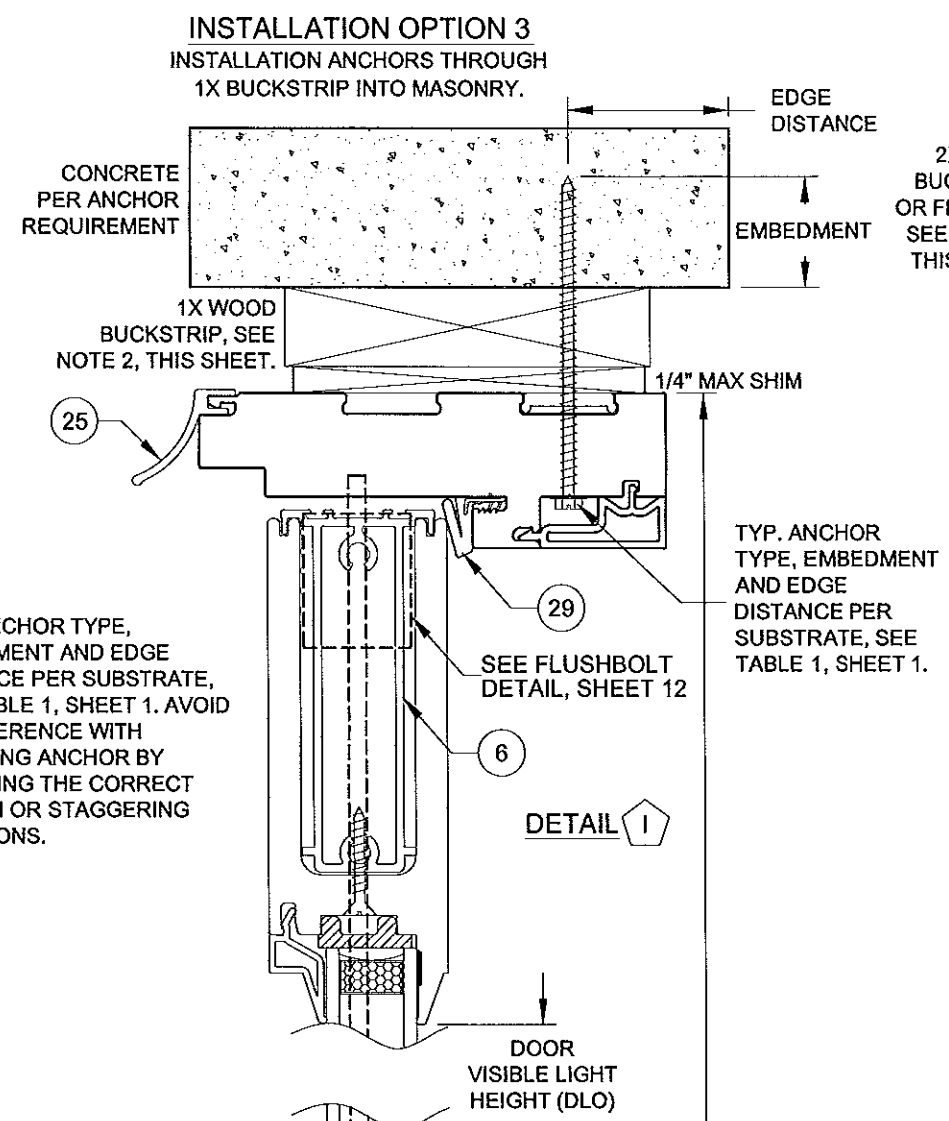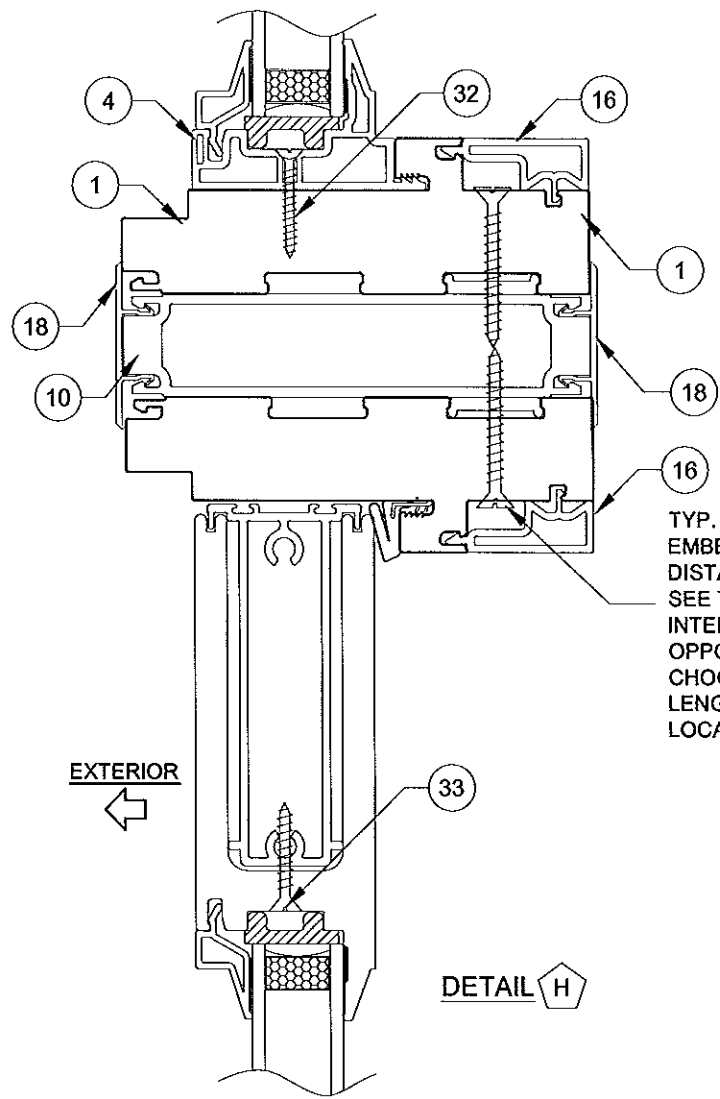

INSTALLATION NOTES:


- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 1, SHEET 1. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE DOOR, SIDELITE OR TRANSOM.
- 2) WOOD BUCKS DEPICTED ON THIS SHEET AS "1X", ARE BUCKS WHOSE TOTAL THICKNESS IS LESS THAN 1-1/2". 1X WOOD BUCKS ARE OPTIONAL IF UNIT CAN BE INSTALLED DIRECTLY TO MASONRY. WOOD BUCKS DEPICTED AS "2X" ARE 1-1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- 3) FOR ATTACHMENT TO METAL: THE STRUCTURAL MEMBER SHALL BE OF A SIZE TO PROVIDE FULL SUPPORT TO THE FRAME OF THE DOOR, SIDELITE OR TRANSOM.
- 4) IF APPLICABLE, LOWEST DESIGN PRESSURE FROM DOOR, SIDELITE, TRANSOM OR MULLION APPLIES TO THE WHOLE SYSTEM.

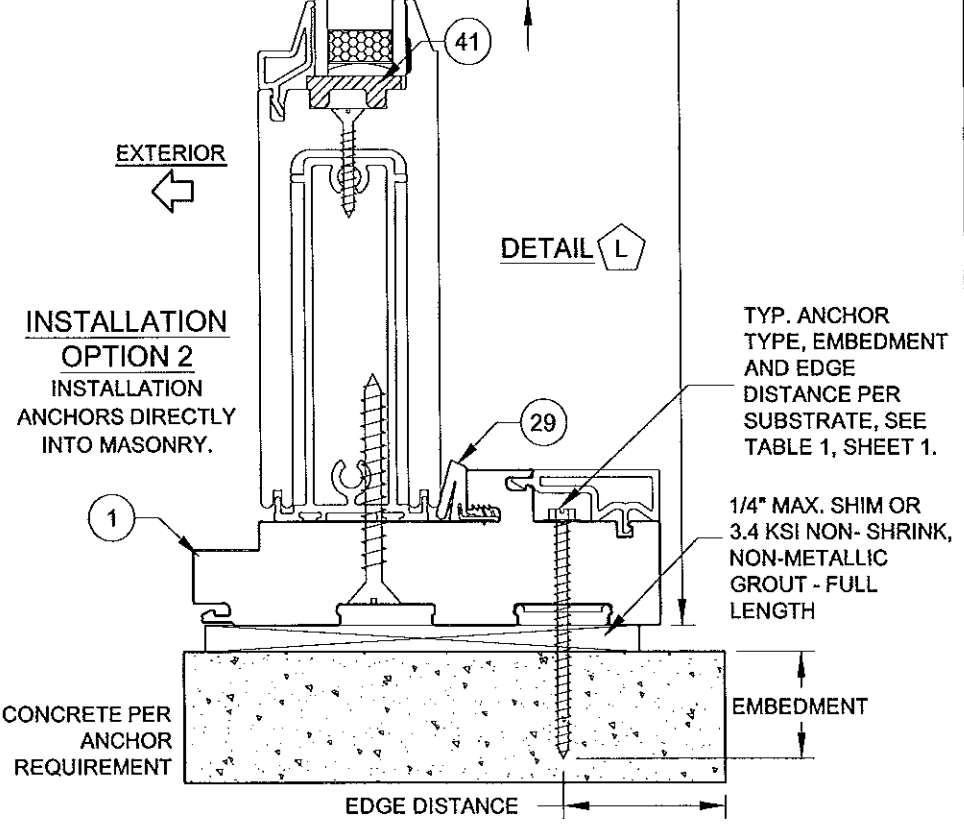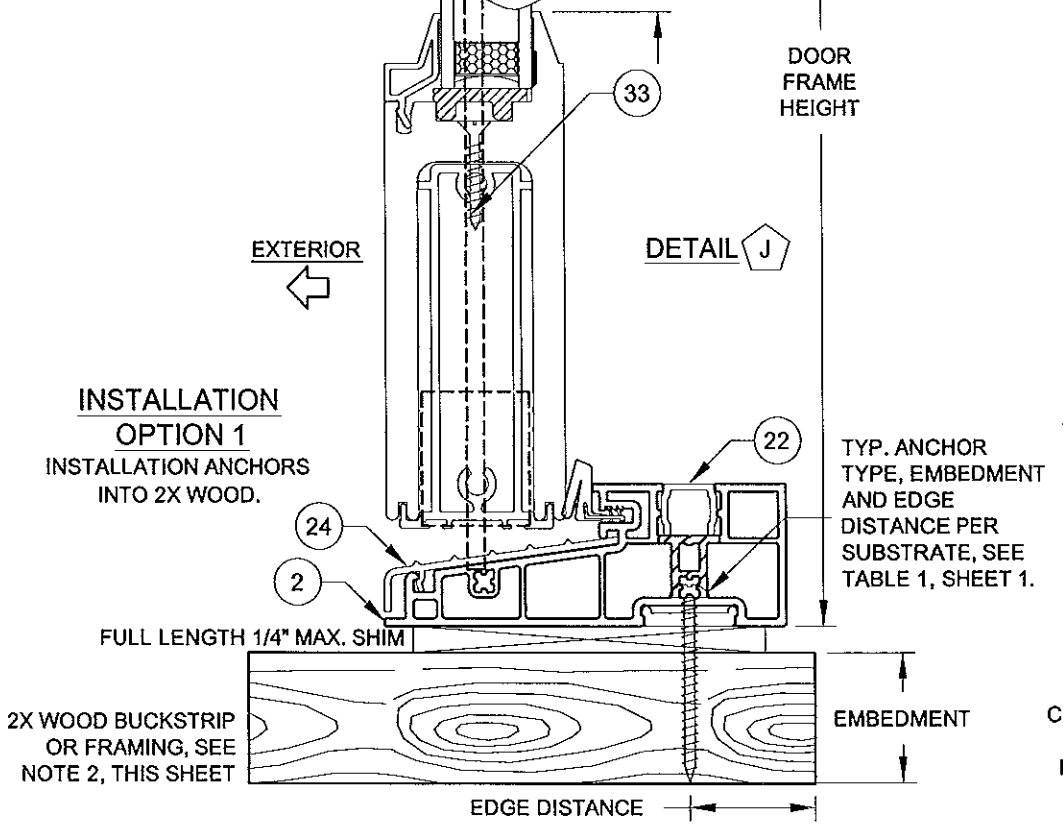


Approved as complying with the Florida Building Code
 Date 01/23/2014
 NOA# 13-0815.04
 Miami Dade Product Control
 By [Signature]


Rev 1	
Rev 2	
Rev 3	

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600 CERT. OF AUTH. #29296	VINYL FRENCH DOOR AND SLT/TR INSTALLATION 3	5/7/13	J ROSOWSKI	Rev.
		Date	By	MD-455.1
		9 OF 12	DWG No.	
		NTS	Scale	
FD-455	Sheet	9 OF 12	DWG No.	MD-455.1
FD-455	Series Desc.	FD-455	NTS	Scale

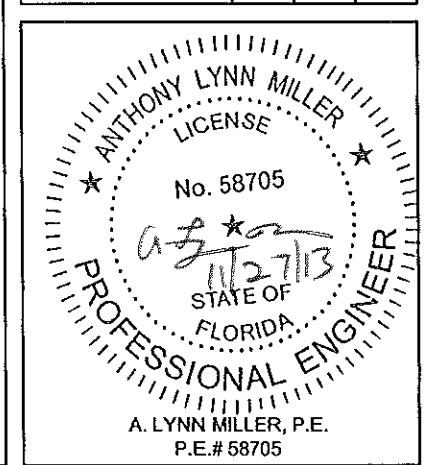


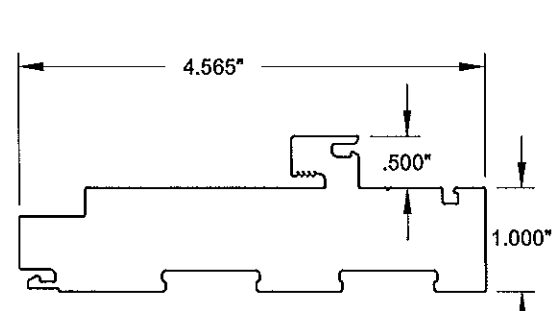


1 **FRAME HEAD & JAMB**
#20000, Cellular PVC

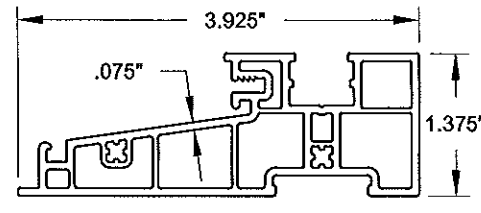


2 **FRAME SILL**
#20001, Rigid PVC

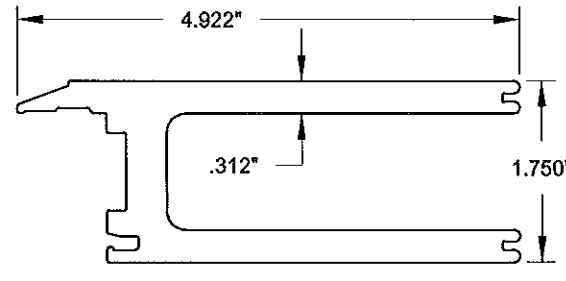


3 **PANEL RAIL & STILE**
#20002, Cellular PVC

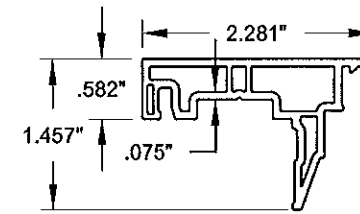


4 **SIDELITE ADAPTER**
#20003, Rigid PVC

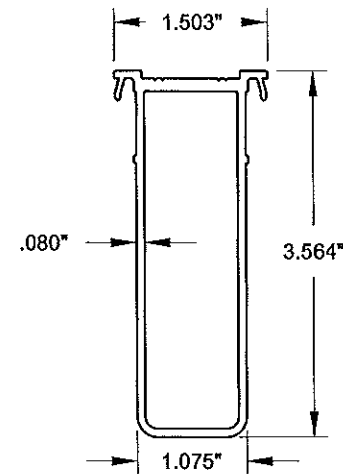


5 **HINGE STILE REINFORCEMENT**
#20013, 6063-T6

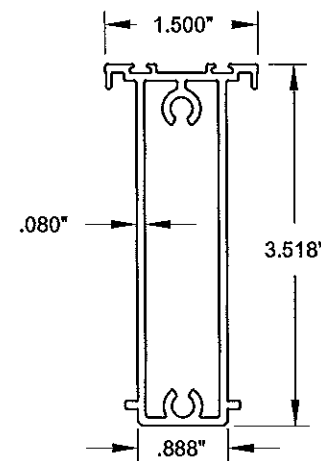


6 **TOP & BOTTOM RAIL REINFORCEMENT**
#20014, 6063-T6

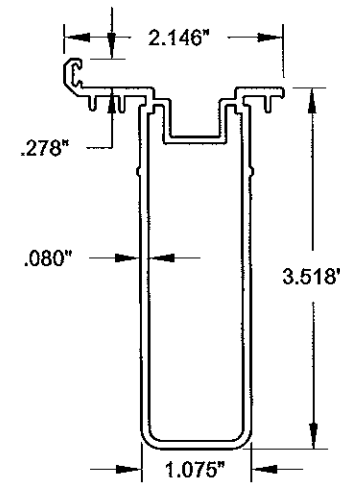


7 **PANEL STILE REINFORCEMENT**
#20015, 6063-T6

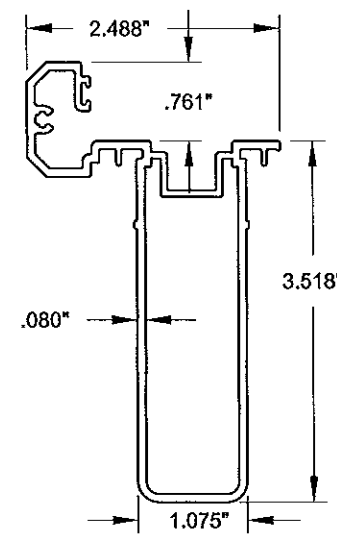


8 **ACTIVE ASTRAGAL**
#20016, 6063-T6

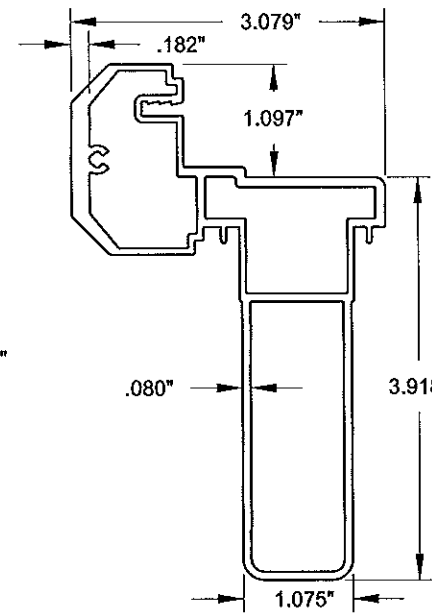


9 **INACTIVE ASTRAGAL**
#20017, 6063-T6

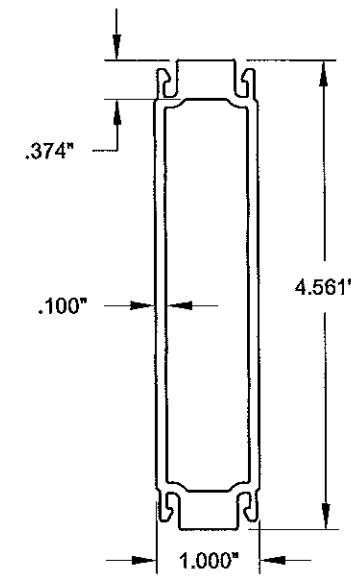


10 **1\"/>**

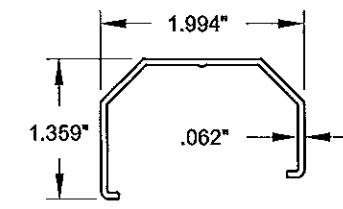


13 **INACTIVE ASTRAGAL COVER**
#20004, Rigid PVC

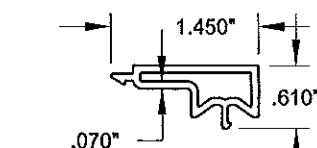


16 **FRAME SCREW COVER**
#20007, Rigid PVC




17 **ADD-ON FIN/FLANGE**
#20008, Rigid PVC




18 **1\"/>**

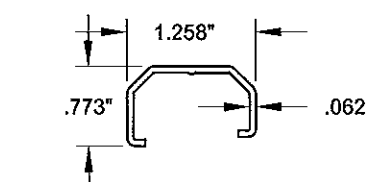


19 **ACTIVE ASTRAGAL COVER**
#20011, Rigid PVC




20 **SINGLE DOOR ASTRAGAL COVER**
#20012, Rigid PVC




22 **SILL CAP**
#19009, Rigid PVC




23 **ANCHOR PLATE**
#19031, 6063-T6

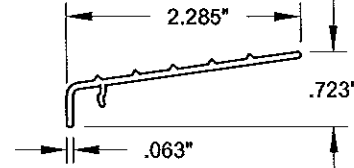


24 **THRESHOLD CAP**
#20020, 6063-T6



25 **DRIP CAP**
#20021, 6063-T6



26 **HINGE TRIM COVER**
#20023, Rigid PVC



27 **7/8\"/>**

Approved as complying with the
Florida Building Code
Date 01/23/2014
NOAH 13-0815.04
Miami Date Product Control
By [Signature]

Rev 1	
Rev 2	
Rev 3	

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600		CERT. OF AUTH. #29296 VINYL FRENCH DOOR AND SLT/TR EXTRUSIONS	Rev.	MD-455.1
			Date	5/7/13
			Drawn By	J ROSOWSKI
			DWG No.	10 OF 12
FD-455	Scale	NTS	Sheet	10 OF 12

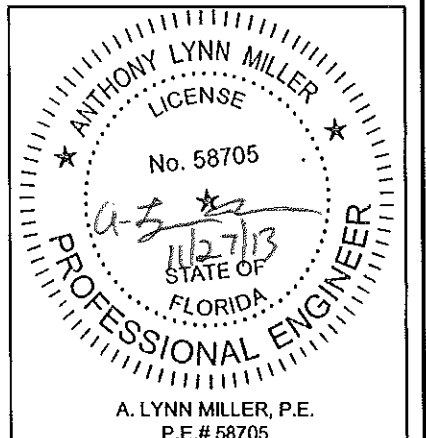



TABLE 10:

#	PGT Part #	Description	Material
1	20000	Door & Sidelite/Transom Main Frame	Cellular PVC
2	20001	Door Frame Sill	Rigid PVC
3	20002	Panel Stile & Rail	Cellular PVC
4	20003	Sidelite Adapter	Rigid PVC
5	20013	Hinge Stile Reinforcement	Alum., 6063-T6
6	20014	Panel Rail Reinforcement	Alum., 6063-T6
7	20015	Panel Stile Reinforcement	Alum., 6063-T6
8	20016	Active Astragal	Rigid PVC
9	20017	Inactive Astragal	Rigid PVC
10	20022	1" French Door Mullion	Alum., 6063-T6
13	20004	Inactive Astragal Cover	Rigid PVC
16	20007	Screw Cover	Rigid PVC
17	20008	Add-on Fin/Flange	Rigid PVC
18	20009	1" Mullion Cap	Rigid PVC
19	20011	Active Astragal Cover	Rigid PVC
20	20012	Single Door Astragal Cover	Rigid PVC
22	20018	Sill Screw Cover	Rigid PVC
23	19031	Anchor Plate	Alum., 6063-T6
24	20020	Threshold Cover	Alum., 6063-T6
25	20021	Drip Cap	Rigid PVC
26	20023	Hinge Trim Cover	Rigid PVC
27	20024	7/8" Beveled Bead	Rigid PVC
28		Fin Weatherstrip	
29	1671/3	Frame Weatherstrip	
31	714FPT410XW	Frame-to-Wide Slab Screw: #14 X 1-1/2" Ph. FH, 16.625" O.C.	Stainless Steel
32	7S101X	Frame-to-Nar. Slab Screw: #10 X 1" Ph. FH, 28" O.C.	Stainless Steel
33	78X1FPT410	Reinforcement Screw: #8 X 1" Ph. FH, 18" O.C.	Stainless Steel
34	710X2FPAX	Frame Assembly Screw: #10 X 2" Ph. FH	Stainless Steel
35	714FPT410XW	W-W Slab Assembly Screw: #14 X 1-1/2" Ph. FH	Stainless Steel
37	71420X2.25	N-W Slab Assembly Screw: #14 X 2-1/4" Ph. FH	Stainless Steel
39		Quanex DuraSeal Spacer, Composite Sealant/Dessicant	
40	62689	Quanex SuperSpacer, Foam EPDM w/ Dessicant	
41	720026	Settling Block, (Duro.=85 +/- 5)	EPDM
42		Backbedding: Dow-995 or GE-7700	Silicone
43		Argon Gas	
44	6HL5140	Hot Melt Butyl	
47 - 73 see Hardware BOM, Table 9, Sheet 12			
90	20033	Inactive Astragal Cap	Acetal
91	20035	Active Astragal Cap	Acetal

ALL RIGID AND CELLULAR PVC BY VISION EXTRUSIONS, LTD.
ANCHOR O.C. DIMENSIONS SHOWN AS MAXIMUM.

DAYLITE OPENING (DLO) SIZES

WHEN USING PART # 3: (WIDE RAILS OR STILES)
X DOOR FRAME HEIGHT - 12.1 = DLO HEIGHT
X DOOR FRAME WIDTH - 12.3 = DLO WIDTH
(XX DOOR FRAME HEIGHT / 2) - 12.1 = DLO HEIGHT
(XX DOOR FRAME WIDTH / 2) - 11.7 = DLO WIDTH
SLT/TR FRAME HEIGHT - 12.1 = DLO HEIGHT
SLT/TR FRAME WIDTH - 12.1 = DLO WIDTH
WHEN USING PART # 4: (NARROW RAILS OR STILES)
SLT/TR FRAME HEIGHT - 4.9 = DLO HEIGHT
SLT/TR FRAME WIDTH - 4.9 = DLO WIDTH

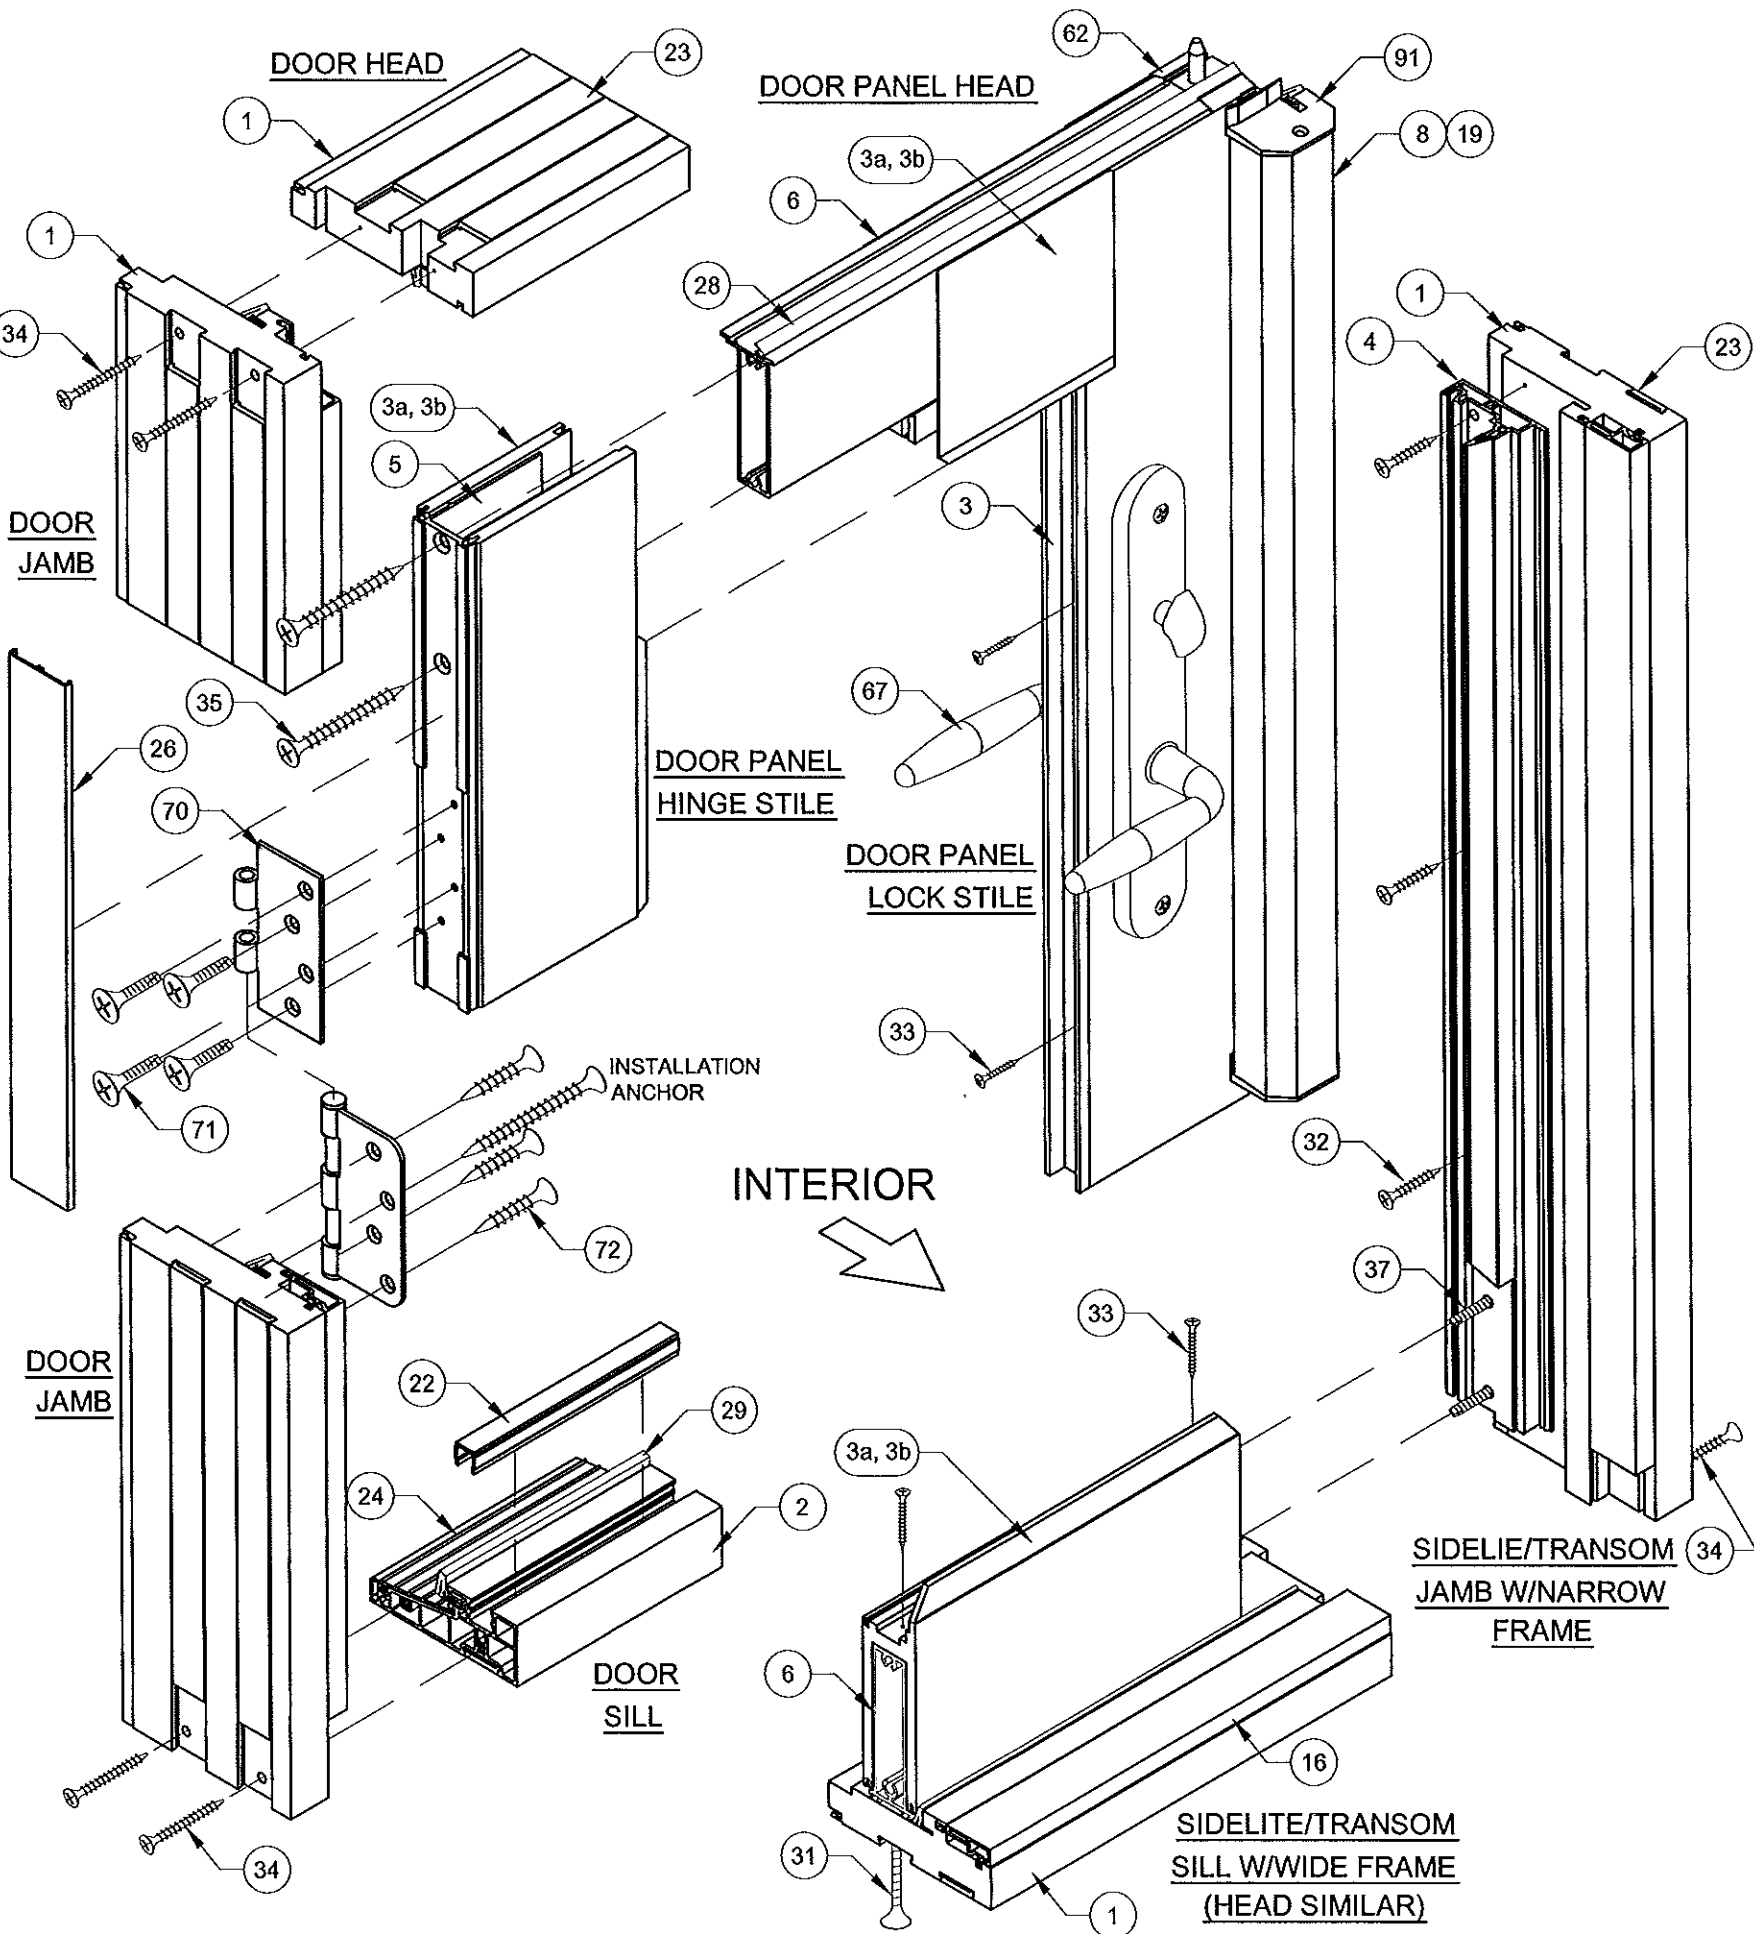

Approved as complying with the
Florida Building Code
Date 01/23/2014
NOAH 13-0815.04
Miami Dade Product Control
By [Signature]

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	5/7/13 Date	J ROSOWSKI By	MD-455.1 Rev
CERT. OF AUTH. #29296	VINYL FRENCH DOOR AND SLT/TR	CORNER DETAILS AND BOM	11 OF 12 DWG
FD-455	NTS	Scale	Sheet
FD-455	NTS	Scale	Sheet

ANTHONY LYNN MILLER
LICENSE
No. 58705
11/27/13
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

HARDWARE DETAILS & LOCATIONS


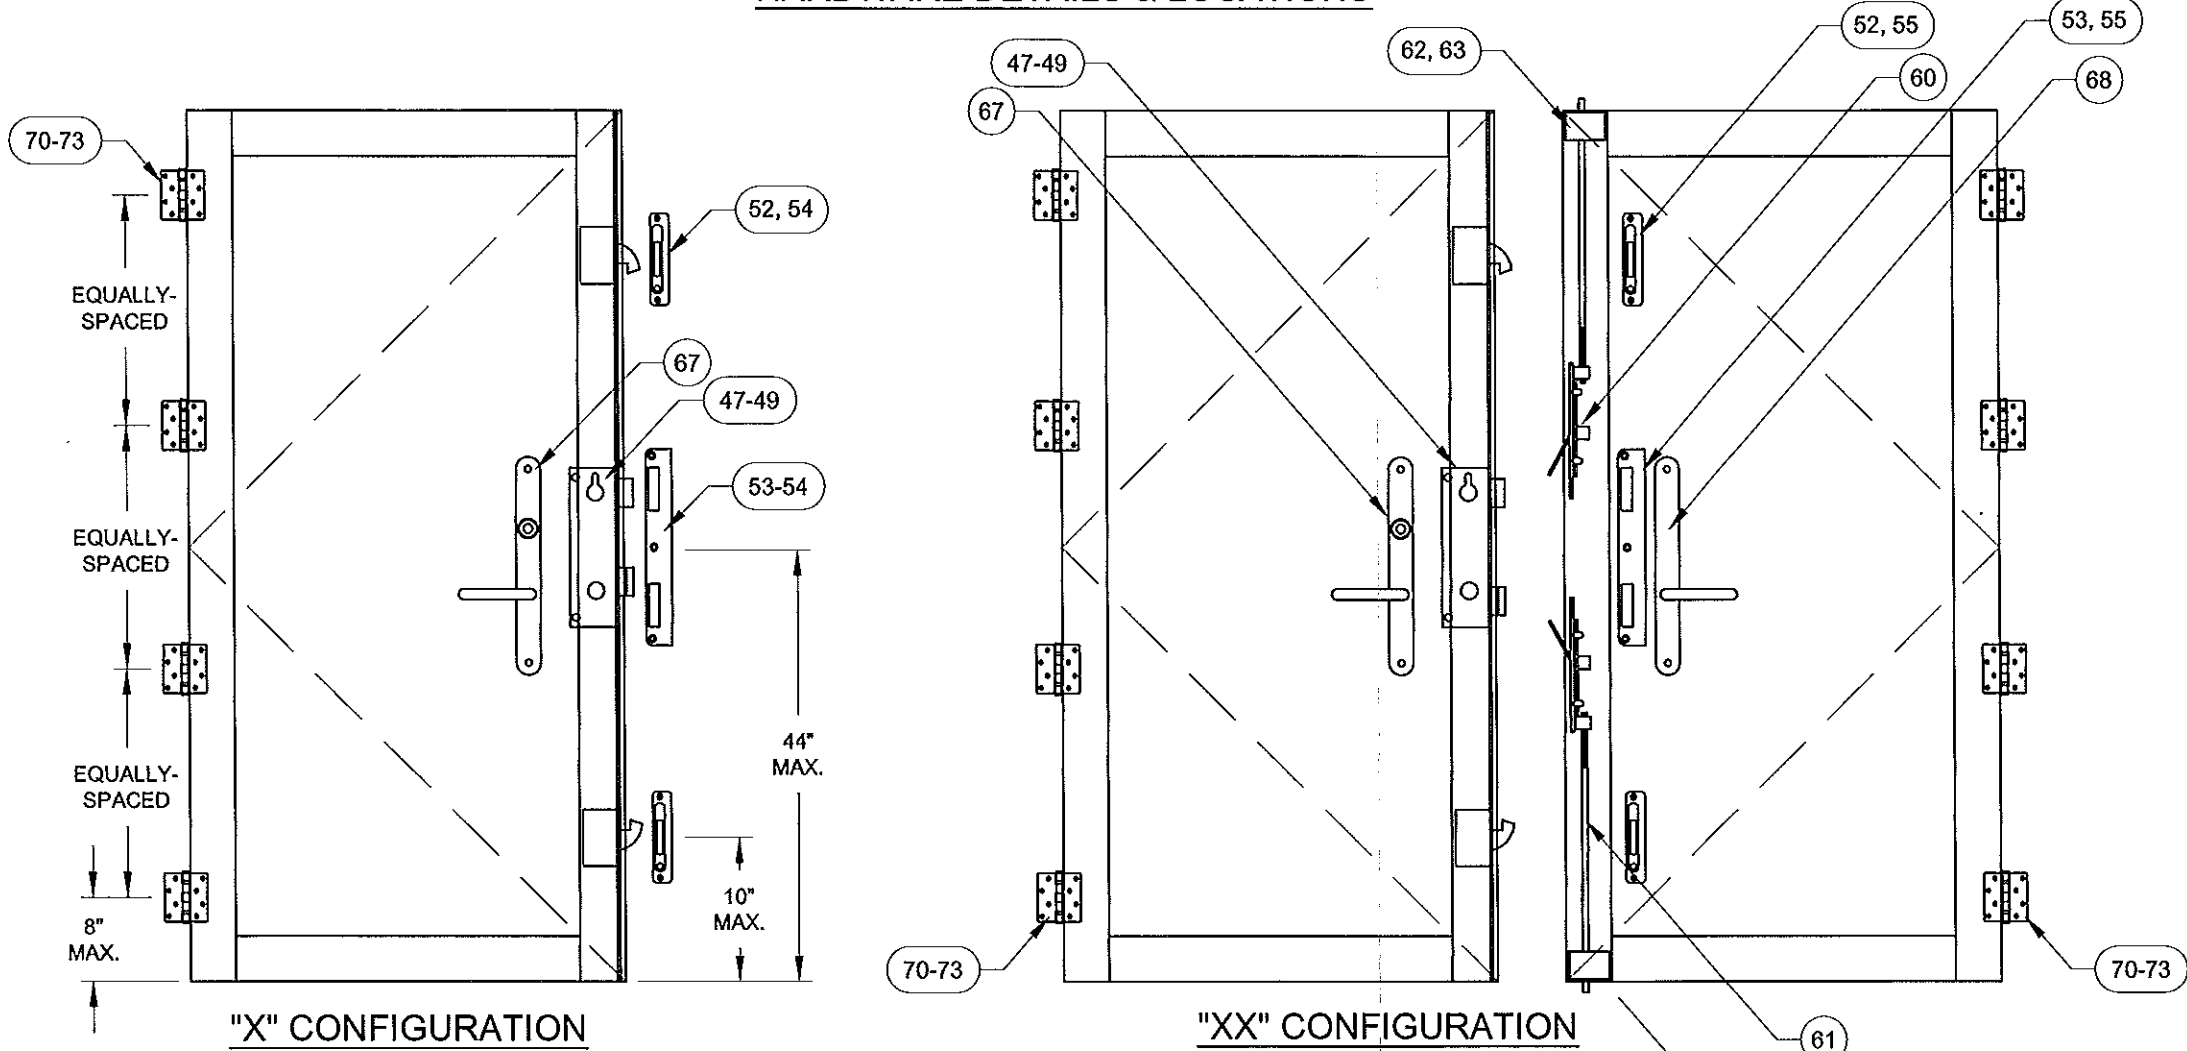


TABLE 11:

#	PGT Part #	Description	Material
47	666032701	P3000 3-PT Rhino Lock (6'8\"), Amesbury Inc.	Stainless Steel
48	666032702	P3000 3-PT Rhino Lock (over 6'8\"), Amesbury Inc.	Stainless Steel
49	71032X1FPFX	Rhino Lock Screw: 10-32 X 1\" Phil. FH	Stainless Steel
52	20027	Adjustable Strike Plate Assembly, Amesbury Inc.	Stainless Steel
53	20028	Center Strike Plate Assembly, Amesbury Inc.	Stainless Steel
54	7S101X	Strike Plate Screw, (X): #10 X 1\" Phil. FH	410 S.S.
55	78X12PFHUX	Strike Plate Screw, (XX): #8 X 1/2\" Phil. FH	410 S.S.
60	7SB1202	Flush Bolt (XX)	
61	7803725	Flush Bolt Rod (XX)	
62	420034	Flush Bolt Guide (XX)	
63	7832X12FPXP	Flush Bolt Guide Screw: 8-32 X 1/2\" Phil. FH	
64	48033N	Guide Pin (XX)	
65	78036	Flush Bolt Strike Plate (XX), Amesbury Inc.	Stainless Steel
66	7832X12FPXP	Flush Bolt Strike Plate Screw, (XX): #8 X 3/4\" Phil. FH	410 S.S.
67	varies	Handle/Lever	
68	varies	Dummy Handle/Lever	
70	20025	Butt Hinge, Amesbury Inc.	Stainless Steel
71	71032X1FPFX	Hinge, Slab Screw: #10-32 X 1\" Phil FH	Stainless Steel
72	7S101X	Hinge, Frame Screw: #10 X 1\" Phil. FH	Stainless Steel


HINGE DETAIL:

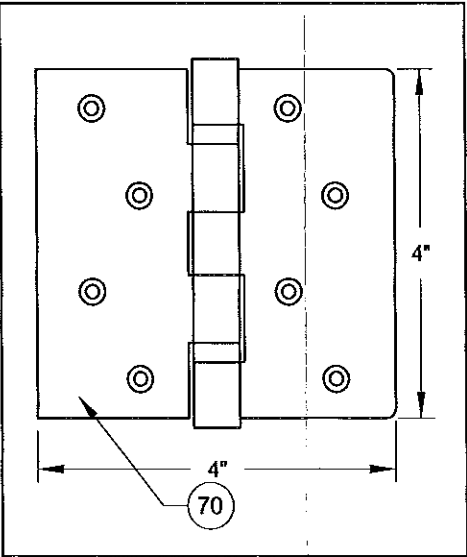

SEE DETAIL,
TOP LOCK
SIMILAR

9/16\"
BEYOND
PANEL

FLUSH BOLT DETAIL:

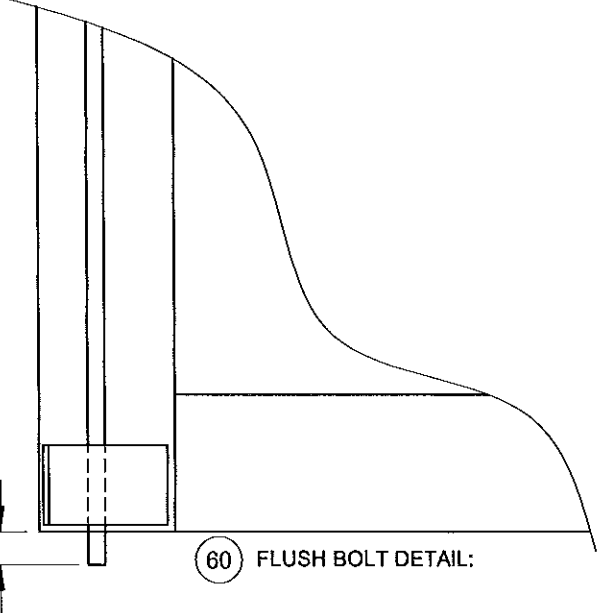

Approved as complying with the
Florida Building Code
Date 01/23/2019
NOA# 13-0815.04
Miami Data Product Control
By [Signature]

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 P.O. BOX 1529 NOKOMIS, FL 34274 (941)-480-1600	Date	By	J ROSOWSKI	Rev.
				MD-455.1
				DWG
				No.
VINYL FRENCH DOOR AND SLT/TR	Date	By	J ROSOWSKI	Rev.
				MD-455.1
				DWG
				No.
DESIGN PRESSURE TABLES 3	Date	By	J ROSOWSKI	Rev.
				MD-455.1
				DWG
				No.
FD-455	Date	By	J ROSOWSKI	Rev.
				MD-455.1
				DWG
				No.

ANTHONY LYNN MILLER
LICENSE
No. 58705
11/27/13
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705